

# CONDENSED CATALOG

## PART-II

Fixed Gas Detector and other instruments

Gas Detector for Combustible Gases/Oxygen/Toxic Gases



# “Creating safe working environments for workers”

RIKEN KEIKI was established in 1939 as part of RIKEN conglomerate (currently called RIKEN, a national R&D corporation). For nearly eight decades since its birth, it has dedicated itself in developing unique technology for the industry. In our living environment, environmental pollution is threatening our lives and precious assets.

Even before there were any warnings of an environmental crisis, we have contributed to society with our industrial pollution/disaster prevention instruments.

At present, we produce from large-scale gas detecting alarm systems to small-sized personal gas monitors for safety protection in many industries.

In addition, our gas detector are widely used in the semiconductor and space development industries.

We also have a large share of gas measuring instruments in the fields of pollution prevention and health care.

With growing needs for disaster prevention and environmental preservation, we are determined to continue developing reliable technologies utilizing our scientific knowledge and skills under the eternal goal of safety "Creating safe working environments for workers."



# CONTENTS



System Configuration Example	3
Necessity of Maintenance, Enhanced Support Network	4
Explosion-proof Calorimeter	5
Smart Type Gas Detector Head	7
Explosion-proof Diffusion Gas Detector Head	9
In-furnace Safety Monitor	10
Multipoint Indicator/alarm Unit	11
Multipoint Indicator/alarm System	13
Single point Indicator/alarm Unit	14
Monitoring System	15
Gas Detector Head	17
Explosion-proof Gas Detector Head	19
Optical Interferometric Gas Monitor	20
Chemical Tape Gas Detector <Transportable>	21
Infrared Gas Detector	22
Single Point Gas Monitor	23
Photoelectron Spectrophotometer	24
Portable X-ray Diffractometer with a Fluorescent X-ray Analyzer	25
Marine Gas Detection System	26
Danger of Gas	27
Related Laws and Regulations (JAPAN)	30
Explosion-proof Construction	33
List of Detection Principles (Advantage, Construction, etc. of Various Principles)	34

## System Configuration Example


As for the gas detector, they are divided into one that furnishes the detector head to detect the gas and the indicator/alarm unit to indicate and to alarm the concentration in one unit and one that the combination of the gas detector head and the indicator/alarm unit. Products of gas detector head are divided roughly into two kinds. One is the smart type gas detector head with the gas concentration display part which is possible to use also by the sole unit. The detector head is used to confirm the concentration around the detector head in situ. It is also possible to install combined with the indicator/alarm unit to confirm the concentration at the nonhazardous area apart from the detector head. The other is a gas detector head that is combined with the indicator/alarm unit to use because it does not have the gas concentration display. It is used with the indicator/alarm unit assembled to confirm the concentration only at the nonhazardous area and the concentration confirmation in situ where the gas detector head is set up is unnecessary.

As for the indicator/alarm unit, there are single point indicator/alarm unit which is one indicator/alarm unit combined to one gas detector head and multi point indicator/alarm unit to monitor multiple gas detector heads together.

Additionally, there is a system configuration that intensively monitors the signals that each indicator/alarm unit outputs in the monitoring system.


### Example of setting up only gas detector head

With applying the smart type gas detector head, a rotating lamp and an external buzzer can be controlled by only the gas detector head.

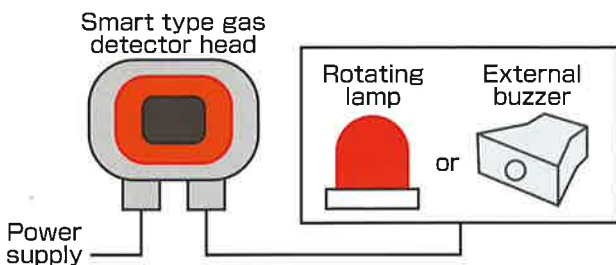


### Example of setting up gas detector head and indicator/alarm unit (single point)

By combining the gas detector head with the indicator/alarm unit, the concentration can be confirmed not only in situ but also at the remote nonhazardous area.

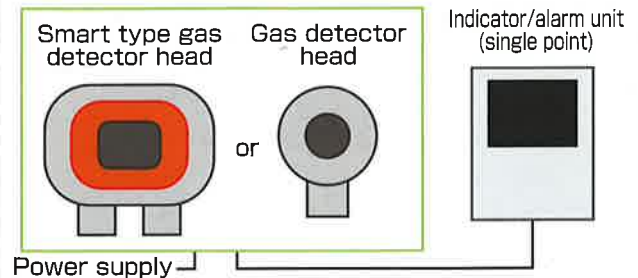


### Example of setting up the gas detector head and the indicator/alarm unit (multi point type)

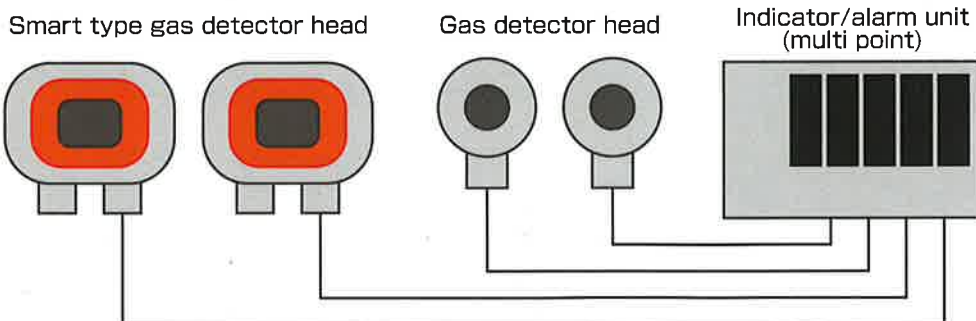

By combining of multiple gas detector heads with an indicator/alarm unit, the concentrations of multiple gas detector heads set up in the site can be confirmed in one place.

### An example of setting up of a gas detector head, indicator/alarm unit and concentrated monitoring system

The gas concentration detected by the gas detector head can be monitored with the monitoring system via the indicator/alarm unit. In the case of a smart type gas detector head is to be used, a system can be composed by incorporating PLC between the smart type gas detector head and the monitoring system, without use of the indicator/alarm unit.

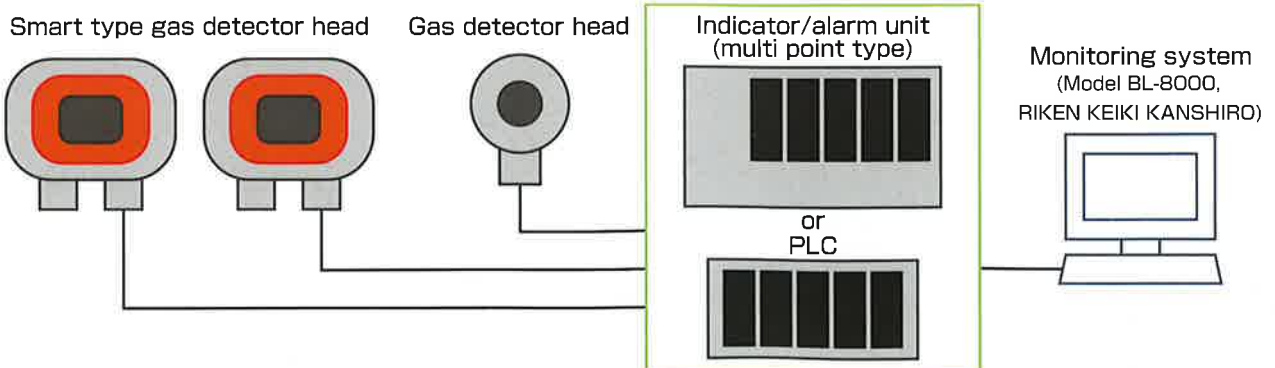

## ▣ Necessity of Maintenance

The implementation of regular maintenance is extremely important to maintain the performance and to improve reliability on disaster prevention and security in using the gas detector. Accurate detection cannot be implemented if the device is continued to use without maintenance.

There are maintenances that are the daily and monthly maintenances to be implemented by the workers and the regular maintenance to be implemented by the service engineer of RIKEN KEIKI. Daily maintenance is a visual check to be implemented by the worker before the beginning of the work. The monthly maintenance is the maintenance of the alarm circuit (alarm test) to be implemented by the worker once a month. The regular maintenance are checks such as the sensitivity calibration etc. to maintain the performance as the security equipment to be implemented once every 6 months.

In Japan, regarding the special high pressure gas, especially, is obligated in Exemplified Standards concerning Safety Regulations for General High Pressure Gas, saying that 'Calibration of the reading of gas leakage detection alarm equipment for special high pressure gas shall be carried out at least once every 6 months'.

With correct execution of maintenance, the performance and the function of the devices can be maintained to be excellent and the safety without the gas disaster can be secured, for a long term.



## ▣ Enhanced Support Network

RIKEN KEIKI is working on the speed up of the emergency response and the regular maintenance.

RIKEN KEIKI has prepared the thorough system for after-sales service with technological members who have expertise and certain technical skill.

RIKEN KEIKI is aiming at the enhancement of the service network. RIKEN KEIKI as the manufacturer of the industrial disaster prevention devices always responds to the consultation and after-sales service with the responsibility concerning the product by allocating service engineers with expertise.

### International bases

North America	United States
South America	Brazil, Argentina, Peru, Chile, Uruguay
Asia-Pacific	China, South Korea, Taiwan, Singapore, Malaysia, Indonesia, Thailand, India, Vietnam, Philippines, Australia
Europe	Germany, Greece, Norway, Turkey, United Kingdom
The Middle East	United Arab Emirates, Israel
Africa	South Africa
Russia	Russian Federation


### 《International Bases》



### Japanese sales bases Japanese service bases

Hokkaido area	Sapporo	Sapporo
Tohoku area	Sendai, Tsuruoka	Iwate, Sendai, Tsuruoka
Kanto and Shinetsu area	Mito, Saitama, Chiba, Kanagawa	Tochigi, Mito, Kashima, Saitama, Chiba, Tokyo, Yokohama, Atsugi, Niigata, Matsumoto, Kofu
Tokai, Hokuriku and Kinki area	Hamamatsu, Nagoya, Yokkaichi, Kanazawa, Osaka, Kobe	Hamamatsu, Nagoya, Yokkaichi-higashi, Yokkaichi, Toyama, Keiji, Amagasaki, Himeji
Chugoku and Shikoku area	Mizushima, Shikoku, Hiroshima, Tokuyama	Mizushima, Shikoku, Higashihiroshima, Hiroshima, Tokuyama
Kyushu and Okinawa area	Fukuoka, Kumamoto, Oita	Tosu, Kumamoto, Oita

### 《Japanese Bases》

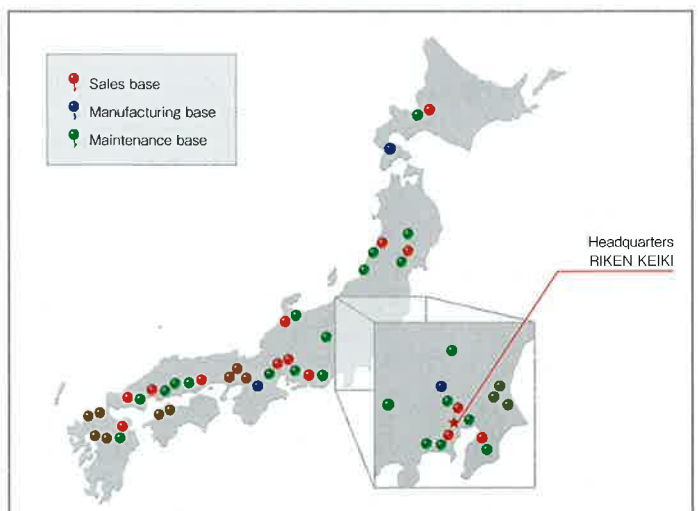

## Model OHC-800

### Features

- Explosion-proof type calorimeter possible to measure calorific value ( $\text{MJ}/\text{m}^3$ ), specific gravity and Wobbe Index continuously.
- Highly accurate and reliable calorimetry of the fuel gas is possible, because the influences of gases (such as  $\text{N}_2$ ,  $\text{O}_2$  and  $\text{CO}_2$ , etc.) having no calorific value in the fuel gas can be removed by the adoption of optosonic calculation developed originally by RIKEN KEIKI.



Calorific value

Specific gravity

Wobbe Index

Methane number

OHC-800 and sampling system RS-400 series


In every country in the world, there is movement to use various fuel gases such as Liquefied natural gas, shale gas, biogas, coal gasification, coke oven gas and methane hydrate, etc. as the safe energy source effectively. OHC-800 is a product of aiming at the enhancement of combustion efficiency/energy efficiency by measuring 'calorific value', 'Specific gravity' and 'Wobbe Index' of the fuel gas.

The highly accurate and reliable measurement has been possible by adopting the calculation method of our original development named optosonic calculation method that combines the optical sensor and the sonic sensor.


It prevents no measurement status owing to the improvement of self-diagnosis function such as diagnostic before the failure. The running cost is excellent as the use of consumables are hardly generated.

### Influence of interference gas for optical sensor and sonic sensor

Both of an optical sensor with results as the principle of calorimeter and sonic sensor (densitometer) were influenced by the interference gases such as  $\text{N}_2$ ,  $\text{O}_2$  and  $\text{CO}_2$ .

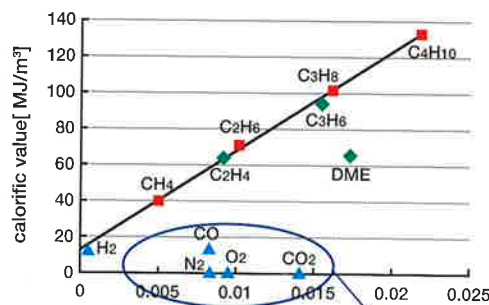

Relation between speed of sound and calorific value (sonic sensor)

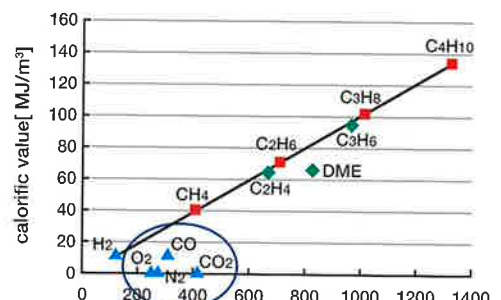

Relation between refractive index and calorific value (optical sensor)


#### Inert gas group

The optical sensor and the sonic sensor are influenced by them though they have no calorific value.

### Accuracy improvement with optosonic calculating method (our original development)

The calculation of our original development named optosonic calculation that combines the optical sensor and the sonic sensor has been adopted. Highly accurate and reliable calorimetry of the fuel gas is possible, because the influences of gases (such as  $\text{N}_2$ ,  $\text{O}_2$  and  $\text{CO}_2$ , etc.) having no calorific value in the fuel gas can be compensated by the adoption of calculation with different two sensors.


Patent No. 518483

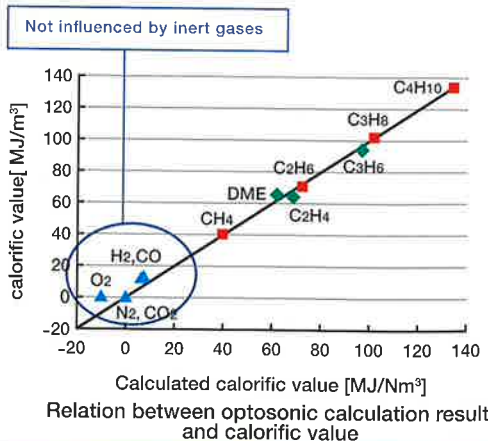

Relation between optosonic calculation result and calorific value

### Establishment of highly accurate and reliable measurement

High accuracy has been confirmed by Chemicals Evaluation and Research Institute, Japan (CERI)

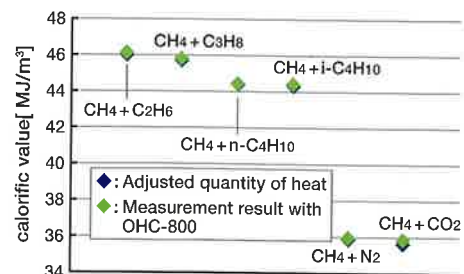

Assessment results by Chemicals Evaluation and Research Institute, Japan (CERI)

## Model of sampling device

OHC-800 is designed to have it incorporated in the specific sampling device RS-400 series. The model of sampling device is selected in accordance with the location where the calorimeter is installed and gas sampling point pressure condition etc.

### Sampling device model

RS-400-



#### Enclosure

- 0: No enclosure
- 1: Enclosure for outdoor (SUS) with shading plate
- 2: Enclosure for indoor (SPCC) with window

#### Use of pressure reducing valve for measuring gas

- 0: Pressure reducing valve not used
- 1: Pressure reducing valve used

#### Bypass flow rate of measuring gas

- 0: Not bypassed
  - 1: 0.5 - 5 L/min
  - 2: 1 - 10 L/min
  - 3: 2 - 20 L/min
- \*\*0: Not bypassed" is applied for the case without pressure reducing valve.

#### Pressure gauge unit

- 1: MPa
  - 2: MPa/PSI double units
- \*\*1: MPa" is selected for the use in Japan because of the Measurement Act.

## Accurate measurement possible owing to the optosonic calculation

Highly accurate and reliable calorimetry of the fuel gas is possible, because the influences of gases (such as N<sub>2</sub>, O<sub>2</sub> and CO<sub>2</sub>, etc.) having no calorific value in the fuel gas are to be compensated by the adoption of optosonic calculation developed originally by RIKEN KEIKI.

## Continuous measurement of calorific value (MJ/m<sup>3</sup>), specific gravity and the Wobbe Index is possible.

As the continuous measurement of calorific value (MJ/m<sup>3</sup>), specific gravity and the Wobbe Index is possible, monitoring of the calorific value in situ is possible.

## The display switching among calorific value (MJ/m<sup>3</sup>), specific gravity and the Wobbe Index is possible.

No calculation is required as the switching of the display unit is possible by only the key operation.

## Explosion-proof for hydrogen

It is possible to use in the hydrogen atmosphere with a robust flameproof enclosure (explosion-proof class: Exd II B+H<sub>2</sub>T4).

## Specification

Model	OHC-800
Measuring principle	Opt-Sonic calculation through measurement of refractive index and sound speed
Measuring gas	CH <sub>4</sub> basis Paraffinic Hydrocarbon gases as represented by Natural Gas <sup>*1</sup>
Measuring targets	Calorific value (density / WOBBE index selectable)
Measuring range <sup>*2</sup>	Calorific value : 25.00~50.00 MJ/m <sup>3</sup> (gross, 0°C, 101.325kPa converted) Density : 0.500~1.500 MJ/m <sup>3</sup> (specific gravity converted)
Measuring method	Constant-flow-rate gas introduction using external sampling devices
Display	Full-dot LCD (with backlight), 3 color LED lamp
External Output	4-20 mA DC (isolated, source current type) maximum load resistance of 300 Ω RS-485 communication
FAILURE alarm	Low flow, Sensor unit abnormality, Low light amount
FAILURE alarm display	Lamp (red) / Content indication on LCD
FAILURE alarm contact <sup>*3</sup>	No-voltage contact 1a or 1b De-energize (energize with alarming) or Energize (de-energize with alarming) Contact capacity of 2 A, 30 VDC (resistance load)
Self-diagnostic function	FUNCTION CHECK (warm-up or maintenance mode), MAINTENANCE REQUIRED, OUT OF SPECIFICATION
Self-diagnostic display	FUNCTION CHECK, OUT OF SPECIFICATION : Lamp (orange) / Content indication on LCD MAINTENANCE REQUIRED : Lamp (green) / Content indication on LCD
Self-diagnostic contact	FUNCTION CHECK, OUT OF SPECIFICATION : No-voltage contact 1a or 1b De-energize (energize with alarming) or Energize (de-energize with alarming) Contact capacity of 2 A, 30 VDC (resistance load) MAINTENANCE REQUIRED : SSR contact, contact capacity of 20 W, 240 VAC (resistance load)
Power supply	100 ~ 240 VAC ±10% 50/60 Hz, max, 18 VA or 24 VDC ±10% max 5 W (the setting can be changed to either the AC or DC)
Ingress Protection level	Equivalent to IP66 and IP67
Operation temperature	-20~+57°C (TIIS)/-20~+60°C (ATEX/IECEX)
Operation humidity	95% RH or less (no condensing)
Outer dimensions / Weight	approx. 286 (W) × 453 (H) × 150 (D) mm / approx. 23 kg
Explosion-proof structure	Flame-proof enclosures (explosion-proof class: Ex II B+H <sub>2</sub> T4 <TIIS> / II 2GExd II B+H <sub>2</sub> T4<ATEX/IECEX>)

\*1 Total concentration of interference gases such as N<sub>2</sub>, O<sub>2</sub>, CO<sub>2</sub>, and CO, etc. contained in a target gas is estimated as less than 20%

\*2 Contact RIKEN KEIKI for the other measuring ranges

\*3 Contact setting is adjustable

## GD-70D series



GD-70D

GD-70D series is a gas detector head to detect toxic gas, oxygen, and combustible gas generated at semiconductor and liquid crystal factory, etc. The reduction of an environmental load has been achieved by reuse of the sensor substrate and recycling of components. Moreover, it also conform to CE marking that is the international standard, and it covers to RoHS Directive.

### Specification

Model	GD-70D	GD-70D-NT	GD-70D-EA
Transmission system	4~20 mADC	DC Power Line Communication	Ethernet /4~20 mADC
Detection principle	Electrochemical, New ceramic, Semiconductor, Galvanic cell or Pyrolysis-particle		
Gas to be detected	Depending on the Detection principle		
Concentration value display	Character LCD display (white backlight) Digital & bar meter display: gas concentration, Alarm setpoint value		
Detection method	Pump drawing type		
Power supply	24VDC±10%	24VDC±10% (dedicated line by blocking filter)	24 VDC ±10% or PoE connection
Power consumption	24 VDC supply: max. 6.5 W PoE supply: max. 8.5 W		
Range of operating temperature and relative humidity	0~40°C (no sudden change) and 30~70% RH (by the installed sensor unit, and non-condensing)		
External dimension/Weight	approx. 70 (W) × 120 (H) × 145 (D) mm (projection portions excluded)/approx. 0.9 kg		


### Gas to be Detected

Target gas	Chemical formula	House standard		ACGIH
		Detection range	Alarm setpoint value	Permissible concentration
Phosphine	PH <sub>3</sub>	0~1ppm	0.3ppm	0.3ppm
Diborane	B <sub>2</sub> H <sub>6</sub>	0~0.3ppm	0.1ppm	0.1ppm
Silane	SiH <sub>4</sub>	0~15ppm	5ppm	5ppm
Nitrogen trifluoride	NF <sub>3</sub>	0~30ppm	10ppm	10ppm
Hydrogen chloride	HCl	0~6ppm	2ppm	2ppm (C)
Hydrogen fluoride	HF	0.4~3ppm	1ppm	0.5ppm
Tetraethoxysilane	TEOS	0~15ppm	10ppm	10ppm
Hydrogen bromide	HBr	0~6ppm	2ppm	2ppm (C)
Chlorine	Cl <sub>2</sub>	0~1.5ppm	0.5ppm	0.5ppm
Fluorine	F <sub>2</sub>	0~3ppm	1ppm	1ppm
Chlorine trifluoride	ClF <sub>3</sub>	0~0.6ppm	0.2ppm	0.1ppm (C)
Ozone	O <sub>3</sub>	0~0.6ppm	0.2ppm	0.2ppm
Nitrogen monoxide	NO	0~100ppm	25ppm	25ppm
Arsine	AsH <sub>3</sub>	0~0.2ppm	0.05ppm	5ppb
Carbon monoxide	CO	0~75ppm	25ppm	25ppm
Ammonia	NH <sub>3</sub>	0~75ppm	25ppm	25ppm
Disilane	Si <sub>2</sub> H <sub>6</sub>	0~15ppm	5ppm	-
Germane	GeH <sub>4</sub>	0~0.8ppm	0.2ppm	0.2ppm
Hydrogen selenide	H <sub>2</sub> Se	0~0.2ppm	0.05ppm	0.05ppm
Bromine	Br <sub>2</sub>	0~1ppm	0.3ppm	0.1ppm
Nitrogen dioxide	NO <sub>2</sub>	0~15ppm	5ppm	3ppm
Sulfur dioxide	SO <sub>2</sub>	0~6ppm	2ppm	0.25ppm
Monomethylamine	CH <sub>3</sub> NH <sub>2</sub>	0~15ppm	5ppm	5ppm
Dimethylamine	(CH <sub>3</sub> ) <sub>2</sub> NH	0~15ppm	5ppm	5ppm
Trimethylamine	(CH <sub>3</sub> ) <sub>3</sub> N	0~15ppm	5ppm	5ppm
Diethylamine	(CH <sub>3</sub> CH <sub>2</sub> ) <sub>2</sub> NH	0~15ppm	5ppm	5ppm
Oxygen	O <sub>2</sub>	0~25vol%	18vol%	-
Hydrogen	H <sub>2</sub>	0~2000ppm	500ppm	-

Contact RIKEN KEIKI for other gas than above.

### Gas to be detected can be changed.

As the sensor units became completely common, gas to be detected became to be able to change among combustible gas, toxic gas, oxygen, etc. only by exchange of the sensor unit.

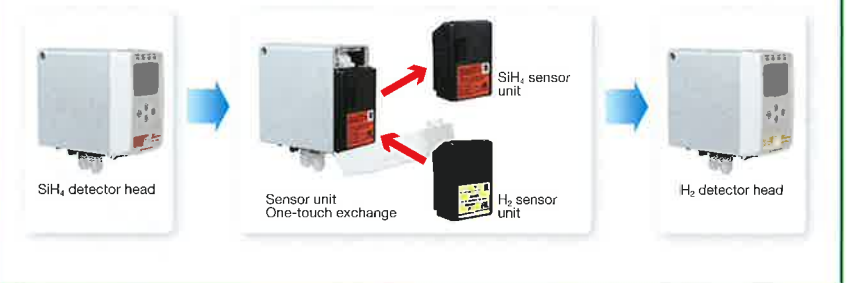

### Multifunctional sensor unit

As a CPU is built in the sensor unit, the sensor information can be always managed, and the operation information (adjustment and trend data) can be understood. Operating information can be recorded in the memory, and a smooth analysis can be expected.


\*Galvanic cell does not conform to RoHS

Electrochemical type	Semi-conductor method	Pyrolysis-particle type
Galvanic cell type	New ceramic catalytic method	




## Screen display that sees easily

The concentration and the gas name, etc. displayed on the screen became easy to read because the screen is large. Moreover, information can be confirmed at a glance by the concentration value display and the concentration level display with the concentration bar.

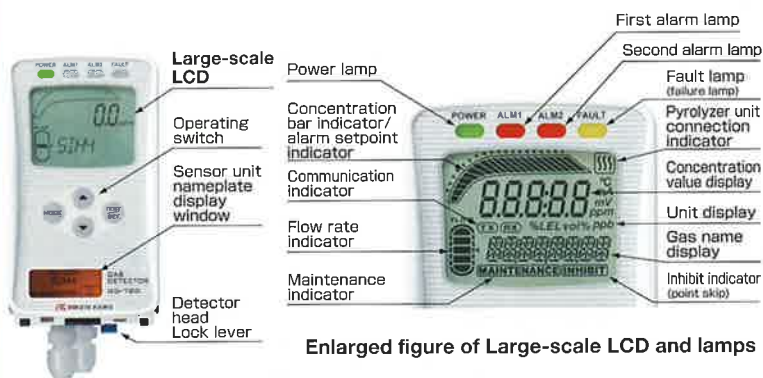

## Flow rate automatic control function installed


Stable gas detection became possible by automatic control of the flowrate of the gas to be detected drawn to the main body to the pre-defined flow rate.

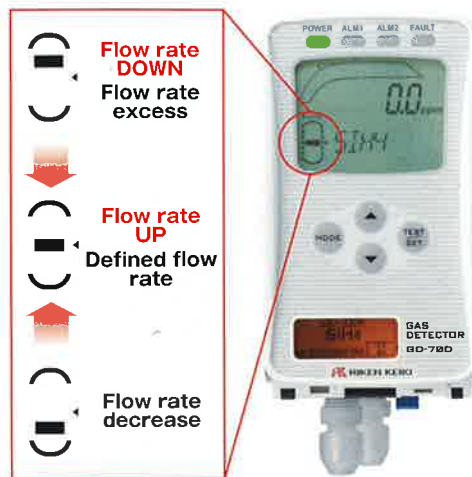

## Covering many kinds of communication methods


### ● Analogue 4 ~ 20mA DC type (using detector head: GD-70D)

Construction of flexible system with gas concentration data output of generic instrumentation signal (4 ~ 20 mA DC) is possible.

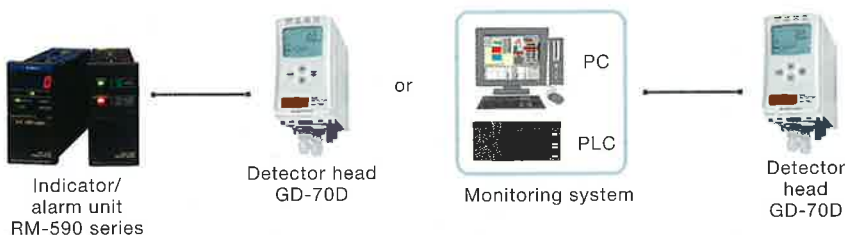


### ● DC Power Line Communication system (using detector head: GD-70D-NT)

As both of the power and the signal lines of the detector head are combined as a communication line, it becomes single. Wire reduced construction can be realized.

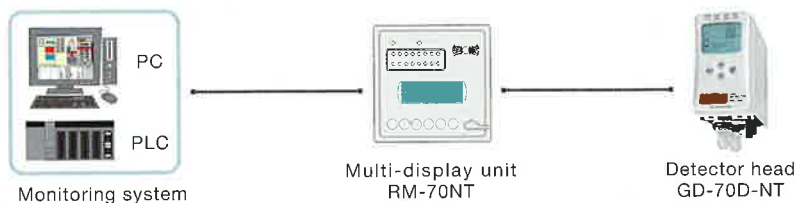

### ● Ethernet System (using detector head: GD-70D-EA)

By means of PoE HUB, power supply with LAN cable is possible. The construction cost can extensively be reduced. Moreover, the operational status etc. of the detector head can be confirmed by Web browser.

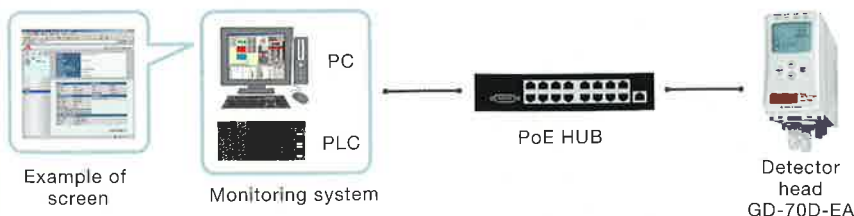


## TEOS and NF<sub>3</sub> detection is possible.

Gas of TEOS and NF<sub>3</sub> detection is possible by connecting the pyrolyzer to the main body.



## High-density mounting is available.

When two main bodies or more are set up in parallel, the space-saving mounting closely located down to min 5 mm (10 mm or more recommended) can be implemented.

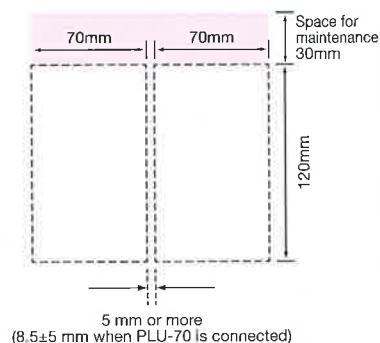

# Explosion-proof Diffusion Gas Detector Head

## SD-1 series



SD-1

The SD-1 series is a small, light, smart type gas detector mainly developed for security and the disaster prevention of such as oil refineries and the petrochemical plants, etc.

The gas detector for Combustible gas, toxic gas and oxygen are lined to this product, and excellent functions such as self-diagnosis etc. based on the intelligent function are provided.

It acquired the certificate for the flameproof enclosures (explosion-proof: Exd II CT5), and covers the use in the hydrogen and acetylene atmosphere.

### Model SD-1 series

## SD-1 D Type GP -AS

Detection method	Detection principle	Drawing method
Without D: Diffusion type With D : Drawing type	Type GP: Catalytic combustion type NC: New ceramic catalytic method RI : Nondispersive infrared ray system	GH: Semi-conductor method EC: Electrochemical type OX : Galvanic cell type
		Without AS: Pump drawing type With AS: Aspirator drawing type

### Covering the use in the hydrogen and acetylene atmosphere

By acquiring the certificate of flameproof enclosures (explosion-proof: Exd II CT5), it can be used in the places such as oil refinery and petrochemistry based product factory, etc. that become hydrogen or acetylene atmosphere.

**Ex d II C T5**

Symbol to indicate explosion-proof construction  
Kind of explosion-proof construction, Flameproof enclosures

Temperature class  
Group of target gas and vapor for factory

Temperature class	T1	T2	T3-T6
Group of target gas and vapor for factory	II A Acetone Ethane	Ethanol Butane	...
	II B	...	...
	II C Hydrogen	Acetylene	...

**Group classification of target gas and vapor for industry**

Group sign	Maximum experimental safe gap (mL)
II A	Equal to or more than 0.9
II B	Over 0.5 and less than 0.9
II C	Equal to or less than 0.5

**Classification of temperature class**

Temperature class	Range of maximum surface temperature (°C)
T1	Over 450
T2	Over 300 and not more than 450
T3	Over 200 and not more than 300
T4	Over 135 and not more than 200
T5	Over 100 and not more than 135
T6	Over 85 and not more than 100

### Easy operation only to touch of control key


As this device can be operated with the control key (magnet) without opening and closing the cover, it can be safely operated even in the explosion-proof place.



### Connection example

Connection cable for Power supply (24 VDC) and gas concentration signal (4 ~ 20 mA DC) is 3 cores. When using contact outputs it is 5 cores.

#### Connection example with alarm monitoring system

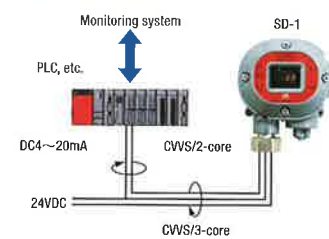

#### Connection example with indicator/alarm unit



### Specification

Model	SD-1		SD-1RI	SD-1GH
Type	Type GP	Type NC	-	-
Detection principle	Catalytic combustion		Non-dispersive infrared	Semiconductor
Gas to be detected	Combustible gas			Combustible gas or toxic gas
Detection range	0~100%LEL	Depending on gas to be detected	0~100%LEL	Depending on gas to be detected
Concentration value display	7 segments LED (4 digits) display			
Detection method	Diffusion type			
Alarm accuracy	Within ±25% to the alarm setpoint value			Within ±25% to the alarm setpoint value (combustible gas) Within ±30% to the alarm setpoint value (toxic gas)
Alarm delay time	Within 30 seconds after giving 1.6 times of gas of alarm setpoint value			Within 30 or 60 seconds after giving 1.6 times of gas of alarm setpoint value (depending on gas to be detected)
Power supply	24VDC (17.0~26.4VDC)			
Power consumption	Max. 3.0 W		Max. 2.0 W	Max. 3.1 W
Range of operating temperature and relative humidity	-20~+53°C (no sudden change), below 95% RH (non-condensing)			
Explosion-proof construction	Flameproof enclosures (Exd II CT5X)		Flameproof enclosures (Exd II CT6X)	Flameproof enclosures (Exd II CT5X)
External dimension/Weight	approx. 148 (W) × 161 (H) × 88 (D) mm (projection portions excluded)/approx. 2.0 kg			

## Smart type gas detector head

### SD-1EC (for hydrogen sulfide, carbon monoxide detection)



#### Features

- To detect hydrogen sulfide leakage around a desulfurization equipment.
- To prevent carbon monoxide poisoning in an ironworks.

#### Specification

Model	SD-1EC
Type	—
Detection principle	Electrochemical
Gas to be detected	Hydrogen sulfide or carbon monoxide
Detection method	Diffusion type
Detection range	Hydrogen sulfide: 0 ~ 30 ppm/Carbon monoxide: 0 ~ 75 ppm * Changeable
Alarm setpoint value	Depending on gas to be detected
Alarm delay	Within 30 seconds after giving 1.6 times of gas of alarm setpoint value
Power consumption	Max. 1.1 W
Range of operating temperature and relative humidity	-10~+40°C (no sudden change) 30~80% RH (non-condensing)
External dimension/Weight (projection portions excluded)	approx. 148 (W) × 203 (H) × 88 (D) mm/approx. 2.2 kg
Explosion-proof	Flameproof enclosures (Exd II CT6X)

## Smart type gas detector head

### SD-10X (for oxygen detection)



#### Features

- For the safety management of checking and cleaning works in underground tunnels.
- For the hypoxia prevention in such as underground culverts.

#### Specification

Model	SD-10X
Type	—
Detection principle	Galvanic cell
Gas to be detected	Oxygen
Detection method	Diffusion type
Detection range	0~25.0vol%
Alarm setpoint value	18.0 vol% (1-step alarm)
Alarm delay	Within 5 seconds after giving gas of 10 ~ 11 vol% and letting it detected in hypoxia alarm
Power consumption	Max. 1.1 W
Range of operating temperature and relative humidity	-10~+40°C (no sudden change) 95% RH (non-condensing)
External dimension/Weight (projection portions excluded)	approx. 148 (W) × 208 (H) × 88 (D) mm/approx. 2.5 kg
Explosion-proof	Flameproof enclosures (Exd II CT6X)

## In-furnace Safety Monitor




SD-2500

#### Features

- High boiling point solvent can be detected.
- Temperature range being assayed for Explosion-proof.  
(0~160°C: Only models GD-A2400 or the SD-2500 covers.)  
(0~200°C: Only model SD-2600 covers.)
- Can be used even in 200°C or higher.  
(operating temperature range 0~250°C: Only model SD-2700 is applicable.)
- The concentration at the core part in the facilities is obtained accurately.
- Concentration display part is integrated to the main body.  
(dedicated indicator/alarm unit not required; effective to Models SD-2500/2600/2700)
- Simple operation only to touch of control key for adjustment.

#### Specification

Model	GD-A2400	SD-2500	SD-2600	SD-2700
Detection principle	Catalytic combustion			
Gas to be detected	Combustible gas			
Detection range	0~100%LEL*	0~100%LEL		
Concentration value display	With an instructor/alarm unit	7 segments LED digital (4 digits)		
Detection method	Direct insertion type			
Alarm delay time	Within 30 seconds after giving 1.6 times of gas of alarm setpoint value *1			
Power supply	Supplied by the indicator/alarm unit	24VDC±10%		24VDC (20~26.4VDC)
Power consumption	—	Max. 3 W		
Range of operating temperature and relative humidity	In-furnace insertion part: 0~160°C (no sudden change) Main body case (ambient temperature): 0~50°C (no sudden change)		In-furnace insertion part: 0~200°C (no sudden change) Main body case: 0~50°C (ambient temperature) (no sudden change)	In-furnace insertion part: 0~250°C (no sudden change) Main body case: 0~50°C (ambient temperature) (no sudden change)
Explosion-proof construction	Flameproof enclosures (Exd II CT3)		Flameproof enclosures (Exd II CT2)	Non-explosion-proof
External dimension/Weight	approx. 148 (W) × 167 (H) × 458 (D) mm (projection portions excluded) In-furnace insertion part: φ 34 × 250/approx. 4.6 kg			

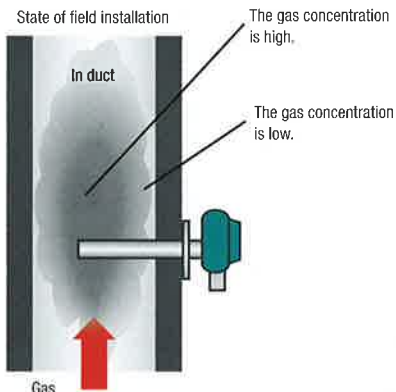


As the length of the in-furnace insertion part is 250 mm, the detection at the core part of high gas concentration is possible.

\* When an indicator/alarm unit is connected

## RM series

■ Multipoint indicator/alarm unit RM series have design and function that can correspond to the densified security instrumentation system. It is a typical series as the gas detection terminal. RM series can combine optimally for wide-ranging use and the usage as it can be used by combining with the gas detector head suitable for various usages.

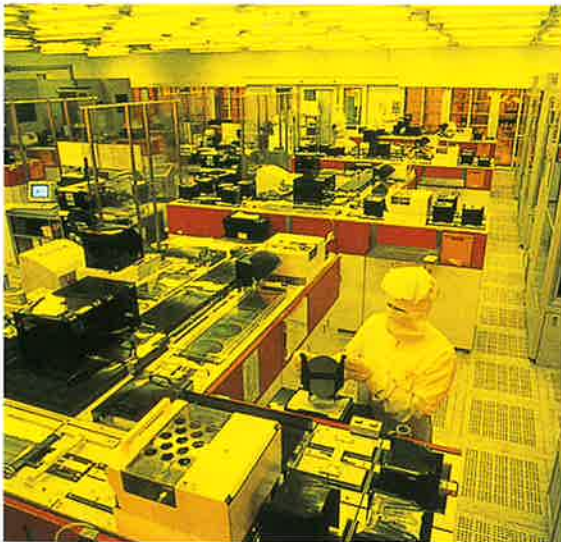

### RM-5000 series

#### Features

- Various gases can be detected by abundant variations.
- Gas concentration is displayed with 2 ways (the bar meter and digital).
- Increased visibility of the detected status by 3 color high contrast LCD adoption.
- Energy-saving achieved (1/4 to 1/6 compared to our old unit).
- Equipped with RS-485 communication function.



Multi case



Single case  
(Buzzer unit)

Single case  
(indicator/alarm unit)

- GP-5001 (for combustible gas)
- NC-5001 (W) (for combustible gas)
- NP-5001 (for combustible gas and inert gas)
- SP-5001 (for combustible gas and toxic gas)
- GH-5001 (for combustible gas and toxic gas)

- EC-5002/5002i \* (for toxic gas)
- OX-5001 (for oxygen)
- OX-5002/5002i \* (for oxygen)
- RM-5002/5002i/5003  
(for 4 ~ 20 mA transmission)
- TAN-5000 (L) (Buzzer unit)

\* Isolation type (insulated type)

### RM-590 series

#### Features

- Digital display easy to see gas concentration.
- Alarm pattern selectable.
- Flow rate decrease signal can be input.
- To-network connectable (optional).



Multi case



Single case  
(indicator/alarm unit)

Single case  
(Buzzer unit)

- GP-591 (for combustible gas)
- NC-591 (W) (for combustible gas)
- GH-591 (for combustible gas and toxic gas)
- EC-592 (for toxic gas)

- OX-591 (for oxygen)
- OX-592 (for oxygen)
- RM-592/593 (for 4 ~ 20 mA transmission)
- TAN-590 (Buzzer unit)



## Specification

Model	GP-5001 NC-5001(W)	NP-5001	SP-5001	GH-5001	EC-5002 EC-5002i	OX-5001	OX-5002 OX-5002i	RM-5002 RM-5002i RM-5003	RM-5003T	Buzzer unit TAN-5000(L)
Detection principle of suited detector head	Catalytic combustion New ceramic	Thermal conductivity	Hot-wire semi-conductor	Semiconductor	Electrochemical Pyrolysis-particle	Galvanic cell		General measurement signal	Semiconductor	—
Gas for indication	Combustible gas	Combustible gas, Inert gas	Combustible gas, Toxic gas		Toxic gas	Oxygen		Combustible gas, Toxic gas, Oxygen, etc.	Carbon monoxide	—
Detector head signal	Direct signal of sensor output				Current signal (4~20mADC)	Sensory output Direct signal	Current signal (4~20mADC)		Current signal (4~30mADC)	—
Transmission distance to the detector head	Within 2.0 km with CVV 2.0 mm <sup>2</sup> cable	Within 2.0 km with CVVS 2.0 mm <sup>2</sup> cable	Within 2.0 km with CVV 2.0 mm <sup>2</sup> cable	Within 2.0 km with CVVS 2.0 mm <sup>2</sup> cable		Within 600 m with CVVS 2.0 mm <sup>2</sup> cable	Within 2.0 km with CVVS 2.0 mm <sup>2</sup> cable	Depending on detector head to be connected.		—
Concentration value display	Character LCD (digital and bar meter <3 colors: green, orange, red>)									
Range of operating temperature and relative humidity	-10~+40°C (no sudden change), below 10~90% RH (non-condensing)									
Alarm contact	Dry contact 1a or 1b each (2 step independent) De-energized in a normal state (energized at an alarm state) or energized in a normal state (de-energized at an alarm state)									
Power supply	24VDC (21.6~26.4VDC)									
Power consumption	Max. 7 W (detector head included)				Max. 3 W (detector head included)	Max. 2 W (detector head included)	Max. 3 W (detector head included)	Max. 2 W (detector head excluded)	Max. 5 W (detector head excluded)	Max. 2 W
External dimensions	approx. 29.6 (W) × 120 (H) × 92 (D) mm (projection portions excluded)									
Weight	approx. 100 g (only for unit)									approx. 80 g

## Connection example between the indicator/alarm unit and the detector head



## Specification

Model	GP-591 NC-591 (W)	GH-591	EC-592	OX-591	OX-592	RM-592 RM-593	RM-593-T	Buzzer unit TAN-590
Detection principle of suited detector head	Catalytic combustion New ceramic	Semiconductor	Electrochemical/ Pyrolysis-particle	Galvanic cell		General measurement signal		—
Gas for indication	Combustible gas	Combustible gas, Toxic gas	Toxic gas	Oxygen		Combustible gas, Toxic gas, Oxygen, etc.	Carbon monoxide	—
Detector head signal	Direct signal of sensor output		Current signal (4~20mADC)	Direct signal of sensor output	Current signal (4~20mADC)		Current signal (4~30mADC)	—
Transmission distance to the detector head	Within 1.25 km with CVV 1.25 mm <sup>2</sup> cable	Within 1.25 km with CVVS 1.25 mm <sup>2</sup> cable		Within 600 m with CVVS 1.25 mm <sup>2</sup> cable	Within 1.25 km with CVVS 1.25 mm <sup>2</sup> cable	Depending on detector head to be connected	Within 1.25 km with CVVS 1.25 mm <sup>2</sup> cable	—
Gas concentration display	7 segments LED digital (4 digits)							
Range of operating temperature and relative humidity	0~40°C (no sudden change), 10~90% RH (non-condensing)							
Alarm contact	Dry contact 1a or 1b each (2 step independent) De-energized in a normal state (energized at an alarm state) or energized in a normal state (de-energized at an alarm state)							
Power supply	24VDC±10%							
Power consumption	Max. 10 W (detector head included)		Max. 5 W (detector head included)			Max. 5 W	Max. 10 W (detector head included)	Max. 2 W
External dimensions	approx. 36 (W) × 72 (H) × 134 (D) mm							
Weight	approx. 100 g (only for unit)							

# Multipoint Indicator/alarm System


Multi gas monitoring system

## RM-700


Whole screen

### Features

- Easy operation with touch panel.
- Multifunctional screen by LCD graphic.
- Information on all points are offered in real time.
- Trend graphs of all points are available at any time.
- Extension facility to BL-NET (multiplex transmission) provided.
- Connectable with various gas detector head.
- Mountable to 19-inch rack.
- Same size as BL-2300 amplifier rack.
- Online maintenance function provided.
- Alarm off function during maintaining provided.



Example of display list

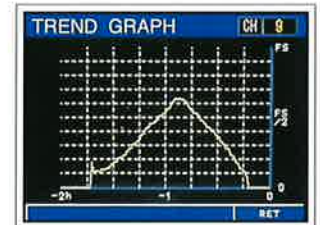

Example of trend graph



### Specification

Model	RM-700						
Suitable detector head	Covering 16 units at maximum according to the selection of amplifier unit						
Model of amplifier unit	700-GP	700-NC	700-GH	700-SP	700-EC	700-OX	700-CU <sup>*1</sup>
Detection principle of suited detector head	Catalytic combustion	New ceramic	Semiconductor	Hot-wire Semiconductor	Electrochemical	Galvanic cell	General instrument signal
Gas concentration display	LCD (6-inch TFT) Graphic panel display						
Range of operating temperature and relative humidity	0~40°C, 20~90% RH						
Integrated alarm contact output	(1) WARNING (1 point) (2) ALARM (1 point) (3) TROUBLE (1 point) (4) CPU DOWN (1 point) 100 VAC 0.5 A (resistance load) De-energized in a normal state (energized type: factory presettable for shipping) A contact (B contact: presettable)						
Individual alarm contact output	Option (OUT1 OUT2 unit required) (1) WARNING or Fault (16 points) (2) ALARM or Fault (16 points) 100 VAC 0.5 A (resistance load) De-energized in a normal state (energized type: factory presettable for shipping) A contact (B contact: presettable)						
Power supply	100VAC±10% 50/60Hz						
Electric power consumption	Max. 180 VA						
Structure	Mountable to 19-inch rack						
External dimensions	approx. 435 (W) × 150 (H) × 346 (D) mm						
Weight	approx. 10 kg						

\*1 General measurement signals other than gas detector can be input (the amplifier unit is 700-CU) <Note> Separate power supply and terminal plate for pump power supply required.

# RM-6000 series

This unit is a one point continuous monitoring type for both marine and land use combinedly. The function, structure and performance are conforming to the related regulations and standards of 'High Pressure Gas Safety Act'.

## Features

- Small, light one point independent continuous monitoring type.
- Easy to install by the independent unit adoption.
- Stepwise management on gas alarm by 2 step alarm type.
- Connectable to various gas detection heads by selecting the unit.



- GP-6001**  
(for combustible gas)
- NC-6001 (W)**  
(for combustible gas)
- GH-6001**  
(for combustible gas and toxic gas)
- SP-6001**  
(for combustible gas and toxic gas)
- EC-6002** (for toxic gas)
- OX-6001/6002** (for oxygen)
- RM-6002/6003**  
(for 4 ~ 20 mA transmission)

## Specification

Model	GP-6001 NC-6001 (W)	SP-6001	GH-6001	EC-6002	OX-6001	OX-6002	RM-6002	RM-6003	RM-6003T
Detection principle of suited detector head	Catalytic combustion New ceramic	Hot-wire Semiconductor	Semiconductor	Electrochemical Pyrolysis-particle	Galvanic cell		General measurement signal		Carbon monoxide (CO)
Gas for indication	Combustible gas	Combustible gas, Toxic gas		Toxic gas	Oxygen		Combustible gas, Toxic gas Oxygen, etc. (general measurement signal)		Semiconductor detector head (GD-A44V)
Detector head signal	Direct signal of sensor output			Current signal (4~20mADC)	Direct signal of sensor output	Current signal (4~20mADC)			Current signal (4~30mADC)
Alarm display	1st: ALM1 red lamp blinking or lighting (after reset) and buzzer sounding 2nd: ALM2 red lamp blinking or lighting (after reset) and buzzer sounding								
Alarm contact	Dry contact 1a or 1b each (2 step independent) De-energized in a normal state (energized at an alarm state) or energized in a normal state (de-energized at an alarm state)								
Power supply	AC specification: 100~240 VAC ±10% 50/60 Hz, DC specification: 24 VDC ±10% (21.6~26.4 VDC) [option]								
Power consumption (pump excluded)	Max.15VA Max.8.5W (detector head included)	Max.11.5VA Max.6W (detector head included)	Max.7.5VA Max.3.5W (detector head included)	Max.6.5VA Max.3W (detector head included)	Max.7.5VA Max.3.5W (detector head included)	Max.7.5VA Max.3.5W (detector head included)	Max.7.5VA Max.3.5W (detector head excluded)	Max.7.5VA Max.3.5W (detector head excluded)	Max.10.5VA Max.7.5W (detector head included)
External output	4~20 mADC (non-insulated, load resistance 300 Ω or less)/digital transmission: RS-485 [option]								
External dimension/Weight	approx. 110 (W) × 190 (H) × 54 (D) mm (projection portions excluded)/wall type: 580 g, embedding type: 650 g								

# Model GP-147



## Specification

Model	GP-147
Detection principle of suited detector head	Catalytic combustion type, New ceramic type
Gas for indication	Combustible gas
Detector head signal	0~6~12 VDC (10 mA or less) [standard] or 4~20 mADC (load resistance 300 Ω or less) [option]
Transmission distance to the detector head	Within 300 m with CVV 0.75 mm <sup>2</sup> cable Within 500 m with CVV 1.25 mm <sup>2</sup> cable Within 500 m with CVV 2.0 mm <sup>2</sup> cable
Concentration value display	Character LCD (bar meter display of 2 colors (red and green))
Range of operating temperature and relative humidity	-10~+50°C (no sudden change), 10~90% RH (non-condensing)
Alarm contact	Dry 1a contact [standard] or 1b contact [option] (contact capacity: 250 VAC 1 A)
Power supply	100~120 VAC or 200~240 VAC Input automatic switching between 50/60 Hz
UPS (uninterrupted power supply)	Lead battery 12 V 2.3 Ah × 2 pieces * With backup point selecting function
External dimension/Weight	2 point type: approx. 305 (W) × 290 (H) × 73 (D) mm / approx. 3.9kg 4 point type: approx. 395 (W) × 290 (H) × 73 (D) mm / approx. 5.0kg 6 point type: approx. 485 (W) × 290 (H) × 73 (D) mm / approx. 5.8kg 8 point type: approx. 575 (W) × 290 (H) × 73 (D) mm / approx. 6.6kg 10 point type: approx. 665 (W) × 290 (H) × 73 (D) mm / approx. 7.4kg 12 point type: approx. 755 (W) × 290 (H) × 73 (D) mm / approx. 8.2kg

## Features

- 12 units at maximum can be mounted. Extension is easy owing to the connecting case adoption.
- Respective existence of backup by UPS (uninterrupted power supply) for each connected detector head can be set.
- LCD display of 2 colors (green and red) easily identifiable from even remote place.
- Thunderbolt cared specification.


## Multiplex Transmission System

# Model BL-8000


Model BL-8000 is a gas detector alarm system with a multiplex transmission optimal for an integrated monitoring from small scale (tens of points) to medium scale (several thousand points).

### Features

- Data can be collected and monitored by disposing the factory computer and sharing a multiplex transmission line with other signal conversion units.

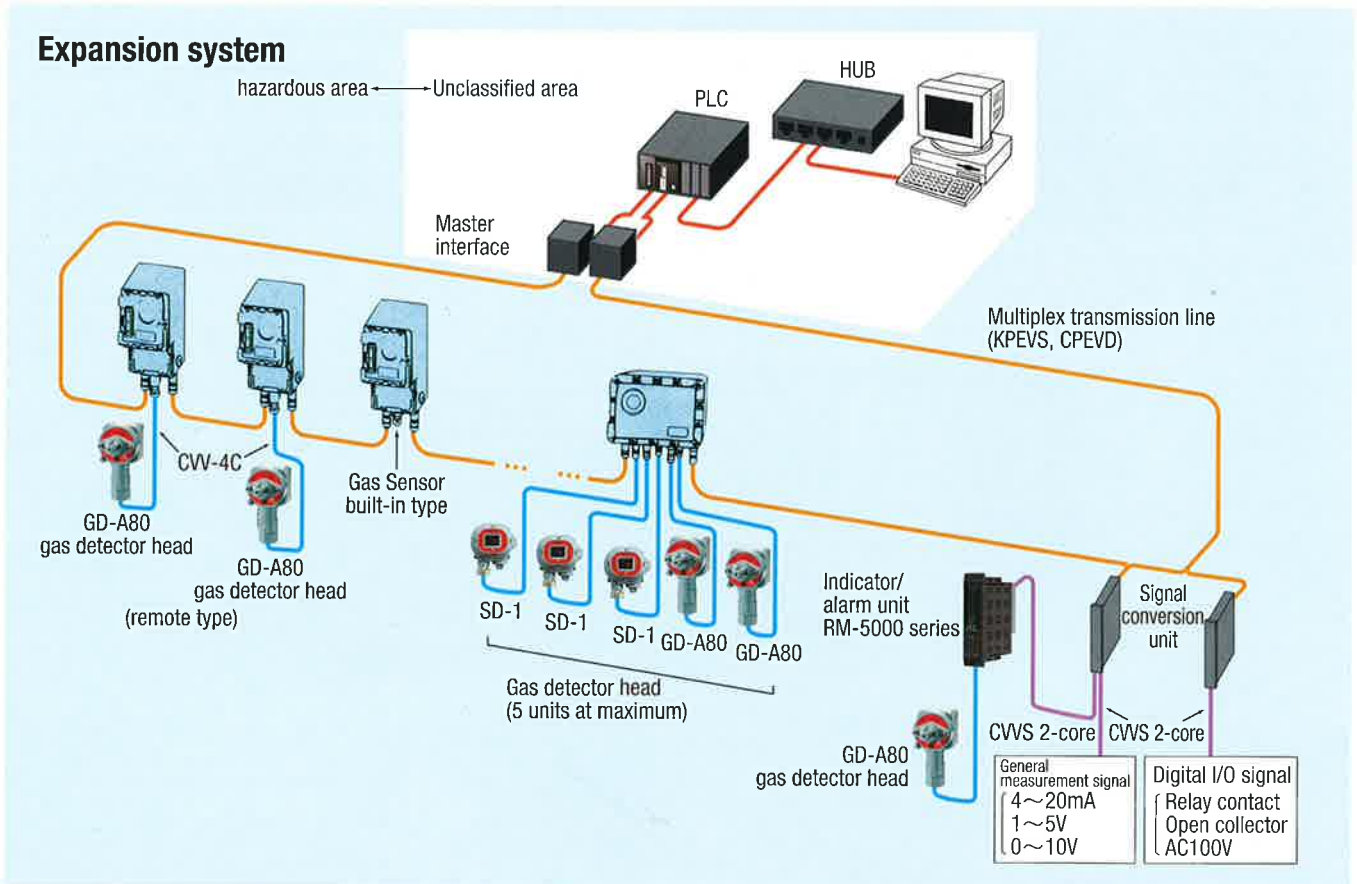

### Example of screen

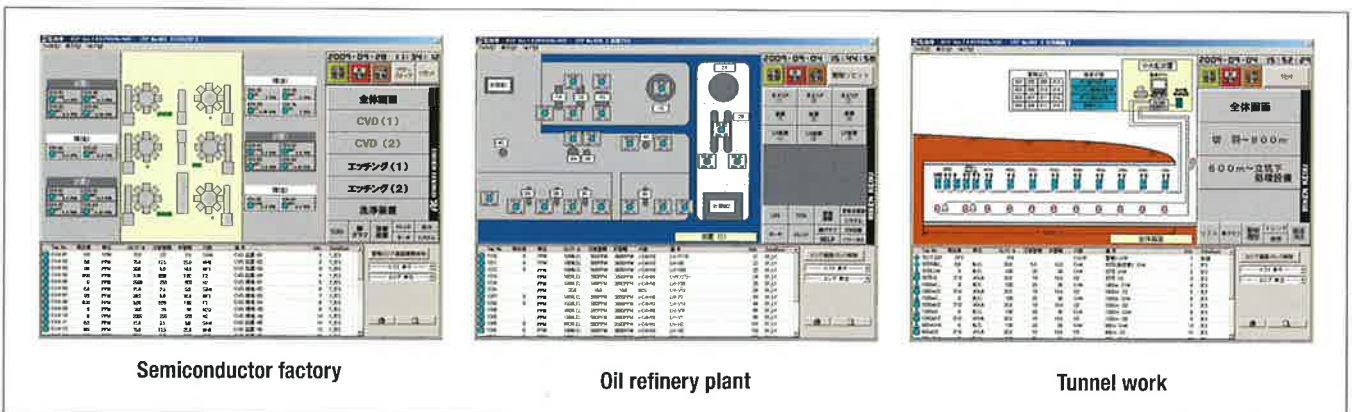



# RIKEN KEIKI KANSHIRO

## Features

### ● Does not overlook the danger on the site

When the gas leakage is happened, it is automatically displayed on the generation area of the screen, and the site of incidence is informed.


### ● Easy operation which can be remembered if it is used once

Easy to see and required information is available soon with an easy operation. Trend graphic display that tends to become complex is simple and intuitive.

### ● Help for report making

Please utilize print data or data taken out into a removable disk for report making, etc. by the output function of information such as the alarm history and the trend graph.

## Alarm pattern

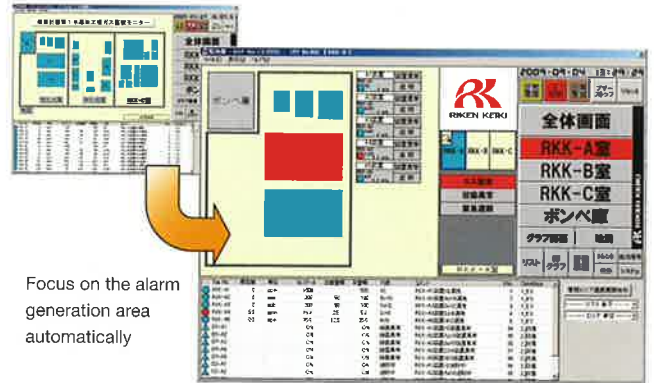

Focus on the alarm generation area automatically

## Basic display

### List screen



The place wanted to see can be searched soon by switching over the area scale or data base scale.

### Bar chart




The state of the alarm can be confirmed at one view of the graph, the color of which changes.

### Alarm history record



20,000 data stored at maximum. The retrieval function has been enhanced, too.


### Trend graph



10 seconds cycle, preserved for more than 1 month. Easy operation only with a mouse.

## Advanced function

### Report (daily report and monthly report)

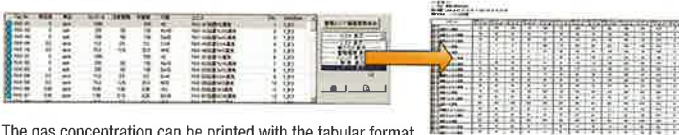

The gas concentration can be printed with the tabular format of a day or a month.

### Print function



The screen, the list, and the alarm history table can be printed by an easy click operation.

## Specification


Item	Specification	
Recommended system requirements	OS	Windows7 professional
	CPU	Intel Celeron processor 2.8 GHz or better
	Memory	2 GB or more
	HDD	80 GB or more
	Display	Resolution XGA (1024 x 768) or more
Display function	List screen	Unit of data base and unit of area screen Display item [Tag No./present value/unit/full scale/warning alarm/real alarm/object/comment/S No./DATABASE]
	Bar chart	Unit of data base and unit of area screen Display item [Tag No./present value/unit/full scale/warning alarm/real alarm/object]
	Alarm history record	Return history display, Tag No. retrieval and object retrieval Can retrieve the State, DataBase/S No. and comment. 20,000 display at maximum
	Trend	Can be preserved for 1 month or more (depending on HDD capacity). 7 points at maximum simultaneous display
	Print	List, alarm history and screen image
Advanced function	Report	Display and print of daily and monthly report
	Alarm history record	CSV file export
	Trend	CSV file export

## Applicable PLC

Omron	CS1 series CJ1 series CJ2 series
Mitsubishi Electric	MELSEC Q series

# Gas Detector Head <for semiconductor and liquid crystal relation>

Explosion proof detector head for semiconductor material gas  
4~20 mA transmission system

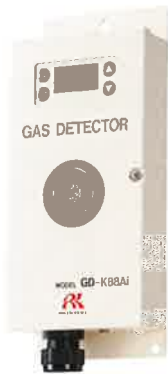

GD-K88Ai



GD-K88Di

## Features

- The power supply and the sensory output to the main body can be covered by only 2 lines.
- Intrinsic safety. Note) Accomplished by the combination with the safety holder (barrier).
- The specification with built-in aspirator is lined up. [option]

## Specification

Model	GD-K88Ai	GD-K88Di
Gas to be detected	Toxic gas	
Detection method	Diffusion type	Drawing type (a pump is separately required).
Detection principle	Electrochemical	
Detection range	Depending on gas to be detected	
Concentration value display	7 segments LCD (4 digits)	
Transmission system	4~20 mA DC loop power (load resistance 300 Ω or less)	
Power supply	24VDC±10%	
Transmission cable	Shielded cable admitted by explosion-proof construction such as CVWS (2-core), etc.	
Range of operating temperature and relative humidity	0~40°C (no sudden change), 30~70% RH (non-condensing)	
Explosion-proof construction	Intrinsic safety (explosion class: Exia II CT4X) * When safety holder (barrier) is used	
Safety holder (recommended)	Zener barrier (MTL728ac) Insulation barrier (MTL5541)	
External dimension (projection portions excluded)	approx. 100 (W) × 241 (H) × 48 (D) mm	approx. 220 (W) × 265 (H) × 90 (D) mm
Weight	approx. 1.0 kg	approx. 2.5 kg

Smart type gas detector head <portable desktop type>



TP-70DG II

## Specification

Model	TP-70DG II	
Detection principle	Electrochemical + pyrolysis (catalyst)	
Type	TYPE C4F6	TYPE COS
Gas to be detected	C4 F6 (detection range: 0~5 ppm)	COS (detection range: 0~15 ppm)
Alarm setpoint value	1st: 2 ppm/2nd: 4 ppm	1st: 5 ppm/2nd: 10 ppm
Concentration value display	Character LCD (digital and bar meter display)	
Detection method	Pump drawing type (drawing flow rate: 0.5 L/min ±10%)	
Power supply display	POWER lamp turning on (green)	
Various displays	Gas name display/flow rate display/mode display/communication state display/pyrolyzer connection display	
External output	Gas concentration signal/gas alarm contact/fault alarm contact	
Alarm accuracy	±30% of alarm setpoint value (under the same condition)	
Alarm delay time	Within 60 seconds after giving 1.6 times of gas of alarm setpoint value * Piping delay not included (under the same condition).	
Gas alarm display	1st: ALM1 lamp blinking or lighting (red)/2nd: ALM2 lamp blinking or lighting (red)	
Gas alarm pattern	Non latching (auto-reset) or fault alarm pattern	
Various functions	White backlight/alarm delay/suppression/zero follower/sensitivity correction Flow control/calibration history/alarm trend history/event history	
Power consumption	Max. 150 VA	
External dimension/Weight	approx. 180 (W) × 225 (H) × 285 (D) mm (projection portions excluded)/ approx. 3.8 kg	

## Features

- Influence of interference is reduced by adopting the pyrolyzer with catalyst.
- New intelligent sensor equipped.
- Automatic flow rate adjusting function installed.

## Specification


Model	TP-70D
Detection principle	Electrochemical, New ceramic, Semiconductor, Galvanic cell
Gas to be detected	Toxic gas, combustible gas, oxygen
Concentration value display	Character LCD display (white backlight), digital & bar meter display
Detection method	Pump drawing type
Power supply	100VAC~240VAC±10% 50/60Hz
Power consumption	Max. 20 VA
Range of operating temperature and relative humidity	0~40°C, 30~70% RH (by the installed sensor unit, and non-condensing)
External dimension/Weight	approx. 160 (W) × 210 (H) × 260 (D) mm (projection portions excluded)/approx. 4.3 kg

## Specification

Model	TP-70DG
Detection principle	Electrochemical + pyrolysis
Gas to be detected	NF3
Concentration value display	Character LCD (white backlight), digital & bar meter display
Detection method	Pump drawing type
Power supply	100VAC~240VAC±10% 50/60Hz
Power consumption	Max. 45 VA
Range of operating temperature and relative humidity	0~40°C, 30~70% RH (by the installed sensor unit, and non-condensing)
External dimension/Weight	approx. 160 (W) × 210 (H) × 260 (D) mm (projection portions excluded)/approx. 5.4 kg

# Gas Detector Head <for oxygen detection>

## Explosion proof oxygen detector head 4~20 mA transmission system



GD-F88Ai



GD-F88Di

### Specification

Model	GD-F88Ai	GD-F88Di
Gas to be detected	Oxygen	
Detection method	Diffusion type	Drawing type (a pump is separately required)
Detection principle	Galvanic cell	
Detection range	0~25.0vol%	
Concentration value display	7 segments LCD (4 digits)	
Transmission system	4~20 mADC loop power (load resistance 300 Ω or less)	
Power supply	24VDC±10%	
Transmission cable	Shielded cable admitted by explosion-proof construction such as CVVS (2-core)	
Range of operating temperature and relative humidity	-10~+40°C (no sudden change), below 95% RH (non-condensing)	
Explosion-proof construction	Intrinsic safety (Exia II CT4X) * When safety holder (barrier) is used	
Safety holder (recommended)	Zener barrier (MTL728ac) Insulation barrier (MTL5541)	
External dimension (projection portions excluded)	approx. 100 (W) × 241 (H) × 48 (D) mm	approx. 220 (W) × 265 (H) × 90 (D) mm
Weight	approx. 1.0 kg	approx. 2.5 kg

### Features

- The power supply to the main body and the sensory output can be covered by only 2 lines.
- With pressure correction function (influence of the atmospheric fluctuation is corrected).
- Intrinsic safety. (Note) Accomplished by the combination with the safety holder (barrier)
- The specification with built-in aspirator is lined up. [option]

## Explosion proof oxygen detector head



GD-F3A-A



GD-F3A-SC-A



GD-F4A-A



GD-F4A-SC-A

### Specification

Model	GD-F3A-A	GD-F3A-SC-A	GD-F4A-A	GD-F4A-SC-A
Detection principle	Galvanic cell			
Detection method	Diffusion type		Drawing type (a pump is separately required)	
Gas to be detected	Oxygen			
Detection range	0~25.0vol%			
Explosion-proof construction	Intrinsic safety by the combination with the Zener barrier (Ex ia II CT4X).			
Cable to be used	Equivalent to CVVS 2-core			
Power supply	-		Depending on the specification of the drawing pump separately used	
Detector head signal	Sensory output Direct signal	Current signal (4~20mADC)	Sensory output Direct signal	Current signal (4~20mADC)

# Explosion-proof Gas Detector Head <for Semiconductor, Electric power, Gas, Civil engineering and various Plants>

## Diffusion type gas detector head Specification

### GD-A80 series



GD-A80



GD-A80V

## Specification

Model	GD-A80	GD-A80V	GD-A80S	GD-A80N	GD-A80-70
Detection principle	Catalytic combustion or New ceramic	Semiconductor	Hot-wire Semiconductor method	Thermal conductivity	Catalytic combustion or New ceramic
Gas to be detected	Combustible gas	Combustible gas, Toxic gas	Combustible gas, Toxic gas	Combustible gas, Inert gas	Combustible gas
Detection method	Diffusion type				
Transmission cable	Cable such as CVV/4-core	Cable such as CVVS/3-core	Cable such as CVVS/4-core	Cable such as CVVS/4-core	Cable such as CVV/4-core
Transmission distance	Depending on each indicator unit				
Power supply	Supplied by each indicator unit				
Range of operating temperature and relative humidity	-20~+53°C (no sudden change), below 95% RH (non-condensing)				-40~+70°C (no sudden change) Below 95% RH (non-condensing)
Explosion-proof construction	Flameproof enclosures (explosion-proof: Exd II CT4)				
External dimension/Weight	approx. 78 (W) × 154 (H) × 105 (D) mm (projection portions excluded)/approx. 1.0 kg				

## Drawing type gas detector head GD-D58 series



GD-D58-AC

### Features

- Drawing pump of large flow rate built-in.
- Flow rate decreasing detector sensor installed.
- Easy maintenance owing to unitizing components to be exchanged periodically.

## Specification

Model	GD-D58-AC		GD-D58-AC-GH	GD-D58-DC		GD-D58-DC-GH
Type	Type GP	Type NC	—	Type GP	Type NC	—
Detection principle	Catalytic combustion	New ceramic	Semiconductor	Catalytic combustion	New ceramic	Semiconductor
Gas to be detected	Combustible gas		Combustible gas, Toxic gas	Combustible gas		Combustible gas, Toxic gas
Detection method	Pump drawing type					
Transmission cable	Cable such as CVV 4-core *1- or 6-core *2		Shielded cable such as CVVS/3-core *1- or 5-core *2	Cable such as CVV 4-core *1- or 6-core *2		Shielded cable such as CVVS 3-core *1- or 5-core *2
Transmission distance	Depending on each indicator unit					
Power supply	100~110VAC±10% · 50/60Hz			24VDC (21.6~26.4VDC)		
Range of operating temperature and relative humidity	-20~+50°C (no sudden change) Below 95% RH (non-condensing)			-20~+53°C (no sudden change) Below 95% RH (non-condensing)		
Explosion-proof construction	Flameproof enclosures (explosion-proof: Exd II B+H <sub>2</sub> T4)					
External dimension/Weight	approx. 197 (W) × 286 (H) × 140 (D) mm (projection portions excluded)/approx. 5.8 kg					

\*1 For the case of wiring power supply and transmission cables separately

\*2 For the case of wiring power supply and transmission in one cable

## Drawing type gas detector head <Concentration value display furnished>

### SD-D58 series



SD-D58-AC

### Features

- Drawing pump of large flow rate built-in.
- Flow rate decreasing detector sensor installed.
- Easy maintenance owing to unitizing components to be exchanged periodically.
- One-man maintenance possible.

## Specification

Model	SD-D58-AC		SD-D58-AC-GH	SD-D58-DC		SD-D58-DC-GH
Type	Type GP	Type NC	—	Type GP	Type NC	—
Detection principle	Catalytic combustion	New ceramic	Semiconductor	Catalytic combustion	New ceramic	Semiconductor
Gas to be detected	Combustible gas		Combustible gas, Toxic gas	Combustible gas		Combustible gas, Toxic gas
Concentration value display	7 segments LED digital (4 digits)					
Detection method	Pump drawing type					
Alarm accuracy	Combustible gas: within ±25% of the alarm setpoint value, Toxic gas: within ±30% of the alarm setpoint value.					
Alarm delay time	Within 30 or 60 seconds after giving 1.6 times of gas of alarm setpoint value (depending on gas to be detected. Neither piping delay nor communication delay is included.)					
Transmission cable	Cable such as CVVS 2- or 4-core			Cable such as CVVS 3- or 5-core		
Transmission distance	Depending on each indicator unit					
Power supply	100~110VAC±10% · 50/60Hz			24VDC (21.6~26.4VDC)		
Range of operating temperature and relative humidity	-20~+50°C (no sudden change), below 95% RH (non-condensing)			-20~+53°C (no sudden change), below 95% RH (non-condensing)		
Explosion-proof construction	Flameproof enclosures (explosion-proof: Exd II B+H <sub>2</sub> T4)					
External dimension/Weight	approx. 197 (W) × 286 (H) × 140 (D) mm (projection portions excluded)/approx. 5.8 kg					

## Drawing pump with hydrogen explosion proof

### RP-D58

## Specification

Model	RP-D58-AC	RP-D58-DC
Power supply	100~110VAC±10% · 50/60Hz	24VDC (21.6~26.4VDC)
Power consumption	Max. 13 VA	Max. 8.6 W
Range of operating temperature and relative humidity	-20~+50°C (no sudden change) Blow 95% RH (non-condensing)	-20~+53°C (no sudden change) Blow 95% RH (non-condensing)
Explosion-proof construction	Flameproof enclosures (explosion-proof: Exd II B+H <sub>2</sub> T4)	
External dimension/Weight	approx. 197 (W) × 286 (H) × 140 (D) mm (projection portions excluded)/approx. 5.8 kg	

## IF series

Commercialized to be able to use more advanced function of optoelectronics stably for a long term by combining optical technique of RIKEN KEIKI for 80 years and the latest electronic technologies. The function corresponding to the user needs of specialized field equipped.

### Features

- Optical interferometric principle to be able to measure concentration of all gases by refractive index.
- Continuous accurate measurement of calorific value of natural gas and LPG, etc.
- Range of measurement wide selectable.
- Automatic zero and span calibration.
- Long-term stability owing to microcomputer-control of the metering section temperature.
- Economical running cost owing to few consumables introduced.
- Gases in N<sub>2</sub>, H<sub>2</sub> and He, etc. measurable (optional specification).

## Optical Interferometric Gas Monitor

### FI-800



### Features

- Hydrogen explosion-proof assayed (ExdIIB + H<sub>2</sub>T4X)

### Specification

Model	FI-800
Measuring principle	Optical interferometric
Measuring object gas	Combustible gas/Solvent vapor/Inert gas
External output	4~20 mA load resistance 300 Ω or less
Concentration value display	LCD digital
Detection method	Drawing type (introduction with external unit)
Alarm display	LED lamp blinking (AL1, AL2)
Alarm contact	Dry contact (AL1, AL2)
Fault alarm	Decrease of flow rate, light intensity and contrast
Power supply	100~220 VAC ±10% 50/60 Hz, power consumption: Max. 8 VA
Range of operating temperature and relative humidity	-10~+40°C (no sudden change), below 80% RH (non-condensing)
Explosion-proof construction	Flameproof enclosures (Exd II B+H <sub>2</sub> T4)
External dimension/Weight	approx. 220 (W) × 332 (H) × 122 (D) mm (projection portions excluded)/approx. 16 kg

### FI-815A



### Specification

Model	FI-815A
Measuring principle	Optical interferometric
Measuring object gas	Various solvent vapors in atmosphere
Measuring range	0~100%LEL
Structure	Rack mount type
Measuring method	Pump drawing type (drawing flow rate: 1.0 L/min or more)
Response time	T90 Within 15 second (put in the gas from gas IN).
Concentration value display	LCD digital (the least digit 1% LEL)
Concentration output	4~20 mA (electric current discharge type) permissible load resistance 300 Ω or less
Alarm contact	AL1 and AL2 1a each Contact capacity: 125 VAC 1 A/30 VDC 1 A (resistance load)
Fault alarm	Decrease of flow rate, light intensity and contrast
Power supply	100 VAC ±10% 50/60 Hz, power consumption: Max. 17 VA
Range of operating temperature and relative humidity	-10~+50°C and below 95% RH (gases dewing/condensing in the unit unapplicable)
External dimension/Weight	approx. 370 (W) × 150 (H) × 266 (D) mm/approx. 6 kg

# Chemical Tape Gas Detector <Transportable>

Highly sensitive toxic gas monitor optimal for low concentration gas management

## FP series

This is a highly sensitive toxic gas monitor that is hardly influenced by interference gases because of using detection tape.

As the detection tape reacts with gas to be detected chemically, the detection is hardly influenced by hydrogen and organic solvents, etc. and the tape shows its true ability for the low concentration management of the target gases at the exit, etc. of the detoxifying apparatus. Moreover, for the detection tape exchange, as one-touch cassette system is adopted, the tape detaching can easily be executed without fail.

### Features

- Optimal for the environment monitor of a clean room.
- The detection sensibility is extremely high and it is optimal for the monitoring of the low concentration (ppb detection).
- It excels in selectivity, and is not interfered with other gases.
- The exchange of tapes is easy owing to the cassette in system.
- Remaining quantity indicator of the tape is provided.



FP-300  
FP-301



Detection  
tape



FP-300AGZS

### Specification

Model	FP-300
Detection principle	Chemical tape method
Gas to be detected	Toxic gas: Semiconductor special material gas
Alarm accuracy	Within $\pm 20\%$ of alarm setpoint value (under the same condition)
Detection tape and time used	1 month (without alarm) Remaining tape quantity indication provided With a prior notice and warning of tape end
Alarm setpoint value (2 steps)	Depending on gas to be detected
External output signal	4~20 mADC (load resistance 300 $\Omega$ or less)
Power supply	Desktop: 100 ~ 240 VAC $\pm 10\%$ 50/60 Hz Panel mount type: 24 VDC $\pm 10\%$
Power consumption	Desktop: approx. 16 VA/max. 30 VA (tape feeding) Panel mount type: approx. 10 W/max. 20 W (tape feeding)
External dimensions	Desktop: approx. 164 (W) $\times$ 198 (H) $\times$ 263 (D) mm Panel mount type: approx. 164 (W) $\times$ 164 (H) $\times$ 263 (D) mm
Weight	Desktop: approx. 6.5 kg Panel mount type: approx. 5.5 kg

### Specification

Model	FP-301	
Detection principle	Chemical tape method	
Gas to be detected	H <sub>2</sub> Se	AsH <sub>3</sub>
Alarm accuracy	Within $\pm 20\%$ of alarm setpoint value (under the same condition)	
Detection tape and time used	1 month (without alarm) Remaining tape quantity indication provided With a prior notice and warning of tape end	
Alarm setpoint value (2 steps)	1st (WARNING):50ppb 2nd (ALARM):100ppb	1st (WARNING):5ppb 2nd (ALARM):10ppb
External output signal	4~20 mADC (load resistance 300 $\Omega$ or less)	
Power supply	Desktop: 100 ~ 240 VAC $\pm 10\%$ 50/60 Hz Panel mount type: 24 VDC $\pm 10\%$	
Power consumption	Desktop: approx. 16 VA/max. 30 VA (tape feeding) Panel mount type: approx. 10 W/max. 20 W (tape feeding)	
External dimensions	Desktop: approx. 164 (W) $\times$ 198 (H) $\times$ 263 (D) mm Panel mount type: approx. 164 (W) $\times$ 164 (H) $\times$ 263 (D) mm	
Weight	Desktop: approx. 6.5 kg Panel mount type: approx. 5.5 kg	

### Specification

Model	FP-300AGZS	
Detection principle	Chemical tape method	
Gas to be detected	C <sub>2</sub> F <sub>6</sub>	C <sub>2</sub> F <sub>4</sub>
Alarm accuracy	Within $\pm 30\%$ of alarm setpoint value (under the same condition)	
Detection tape and time used	2 months (without alarm) Remaining tape quantity indication provided With a prior notice and warning of tape end	
Alarm setpoint value (2 steps)	1st (WARNING): 2.0ppm, 2nd (ALARM): 4.0ppm	
External output signal	4~20 mADC (load resistance 300 $\Omega$ or less)	
Power supply	100~240VAC $\pm 10\%$ 50/60Hz	
Power consumption	Max. 150 VA	
External dimensions	approx. 250 (W) $\times$ 198 (H) $\times$ 300 (D) mm	
Weight	approx. 9.5 kg	

# Infrared Gas Detector

## RI series

RI series was made into a series as a summarization of long years' RIKEN KEIKI's technology with the infra-red analysis meter. It cover various sites with abundant variations.

### Features

- Easy installation with the space-saving design.
- A little influence of the interference gas.
- Excellent long-term stability.



RI-257



RI-557 <portable>



RI-215A (diffusion type)



RI-215D (drawing type)

### Specification

Model	RI-257
Detection principle	Non-dispersive infrared
Gas to be detected	CFC gas, PFC gas and various solvent gases
Detection range	Depending on gas to be detected
Detection method	Pump drawing type
Alarm	2 step alarm [1st (WARNING), 2nd (ALARM)] Operation: Fault alarm pattern (non latching (auto-reset) after alarm confirmed) Alarm light: Lamp display (yellow/red) Contact output: open contact at a normal state (normal closed contact optional) Contact rating: 125 VAC 0.1 mA~0.5 A (for load resistance)
Alarm setpoint value	Depending on gas to be detected
Alarm accuracy	±30% of alarm setpoint value (under the same condition)
Alarm delay time	Within 30 seconds after giving 1.6 times of gas of alarm setpoint value
External output	4~20 mA load resistance 300 Ω or less
Power supply	100VAC±10% 50/60Hz
Power consumption	Max. 50 W
Range of operating temperature and relative humidity	0~40°C, 30~90% RH (non-condensing)
External dimension/Weight	approx. 180 (W) × 355 (H) × 97 (D) mm (projection portions excluded)/ approx. 3.8 kg

### Specification

Model	RI-557
Detection principle	Non-dispersive infrared
Gas to be detected	CO, CO <sub>2</sub> , CH <sub>4</sub> , etc. in atmosphere
Detection range	Depending on gas to be detected
Detection method	Pump drawing type
Concentration output	4~20 mADC, load resistance 300 Ω or less, or 0~1 VDC
Power supply	100~220VAC±10% 50/60Hz
Power consumption	Max. 25 VA (100 V), Max. 35 VA (220 V)
Range of operating temperature and relative humidity	0~40°C, below 90% RH (non-condensing)
External dimension/Weight	approx. 220 (W) × 200 (H) × 320 (D) mm (projection portions excluded)/ approx. 5.7 kg

### Specification

Model	RI-215A	RI-215D
Detection principle	Non-dispersive infrared	
Gas to be detected	Carbon dioxide	
Concentration value display	LCD display	
Detection range	0~2000ppm (TYPE-2000) 0~5000ppm (TYPE-5000) 0~9990ppm (TYPE-9990) 0~5vol% (TYPE-5)	0~2000ppm (TYPE-2000) 0~5000ppm (TYPE-5000) 0~9990ppm (TYPE-9990) 0~2vol% (TYPE-2) 0~5vol% (TYPE-5)
Concentration display resolution	ppm specification: 1 ppm (detection range: 0 ~ 2000 ppm), 10 ppm (detection range: 2000 ~ 9990 ppm) vol% specification: 0.005 vol% (detection range: 0~2 vol%), 0.010 vol% (detection range: 2~5 vol%)	
Repeatability	Within ±5% F.S (under the same condition)	
Detection method	Diffusion type	Pump drawing type
Drawing flow rate	—	1.0 L/min or more
External output signal	0~10 VDC (load resistance: Min. 500 kΩ) or 4~20 mADC (load resistance: Max. 300 Ω)	
Alarm setpoint value (set value optional)	ppm specification: 1000 ppm vol% specification: 1 vol% [TYPE-2], 2.5 vol% [TYPE-5]	
Alarm contact output	Dry contact 1a	
Range of operating temperature and relative humidity	0~40°C, below 10~90% RH (non-condensing)	
Power supply	24VDC±10% 24VAC±10% 50/60Hz	100VAC±10% 50/60Hz 110VAC±10% 50/60Hz 220VAC±10% 50/60Hz
Power consumption	Max. 4 VA	Max. 12 VA
External dimensions	approx. 78 (W)× 78 (H) ×31 (D) mm (projection portions excluded)	approx. 220 (W) × 265 (H) × 76 (D) mm (projection portions excluded)
Weight	approx. 0.2 kg	approx. 3.6 kg

## RI-2000W(R)



RI-2000W <wall type>

### Features

- For leak detection of N<sub>2</sub>O.
- For leak detection of medical application anesthetic gas cylinder.

### Specification

Model	RI-2000W (wall type)/RI-2000R (19-inch rack installation type)
Detection principle	Non-dispersive infrared
Gas to be detected	N <sub>2</sub> O (nitrous oxide)
Detection range	0~200ppm
Detection method	Pump drawing type
Drawing flow rate	approx. 1.0 L/min or more
Kind of alarm	Gas alarm: 2 step alarm Fault alarm: System abnormal, Flow rate decrease, motor abnormal, etc.
External output	4~20 mA (non-insulated, linear, load resistance 300 Ω or less)
Alarm accuracy	Within ±30% of alarm setpoint value (under the same condition)
Power supply	100 VAC ±10% 50/60 Hz, power consumption: Max. 400 VA
External dimension/Weight (projection portions excluded)	Wall type: approx. 350 (W) × 440 (H) × 160 (D) mm, approx. 17 kg 19-inch rack installation type: approx. 482 (W) × 180 (H) × 402 (D) mm, approx. 16 kg

## Single Point Gas Monitor

- Sensor built-in type and remote sensor type, selectable
- ### OX-600



Main body

Remote sensor [option]

### Specification

Model	OX-600
Gas to be detected	Oxygen
Detection method	Diffusion type or remote detection method
Detection principle	Galvanic cell
Detection range	0~25.0 vol% (1 digit: 0.1 vol%)
Concentration value display	LCD digital display (3 digit 7 segment/3 color backlight: green, orange and red) <sup>*1</sup>
Length of remote cable	3 m, 5 m, 10 m, 20 m
Kind of alarm	Gas alarm: 2 step alarm (fault alarm pattern/cancel with reset switch) Fault alarm: System abnormal, sensor abnormal (non latching (auto-reset))
Alarm setpoint value	1st: 19.0vol% 2nd: 18.0vol%
Alarm history record	10 records from the latest (least concentration and generated date)
External output	4~20 mA DC (non-insulated, load resistance 300 Ω or less) or 0~1 VDC (non-insulated) <sup>*2</sup>
Alarm contact	Dry contact 1a or 1b each, Contact capacity 125 VAC 1 A or 30 VDC 1 A (resistance load)
Range of operating temperature and relative humidity	-10~+40°C (no sudden change), below 90% RH (non-condensing)
Power supply	100 VAC ±10% 50/60 Hz or 24 VDC ±10% or 2 size AA alkaline battery
Power consumption	AC specification: Max. 5 VA DC specification: Max. 3 W
Continuous operating time (dry battery specification)	approx. 1 year (25°C, without Alarm, backlight off)
External dimensions	Main body: approx. 80 (W) × 120 (H) × 35.5 (D) mm Remote sensor: approx. 40 (W) × 96 (H) × 35.5 (D) mm (projection portions excluded)
Weight	AC specification: approx. 200 g DC specification: approx. 180 g Dry battery specification: approx. 230 g Remote sensor: approx. 55 g (cable excluded)

<sup>\*1</sup> Backlight is usually off for dry battery specification. (a part of operation for dry battery specification is different from that of AC and DC specifications)  
<sup>\*2</sup> 0-1VDC only for dry battery specification

- Sensor built-in type and remote sensor type, selectable
- ### EC-600



Main body

Remote sensor [option]

Model	EC-600
Gas to be detected	Carbon monoxide
Detection method	Diffusion type or remote detection method
Detection principle	Electrochemical
Detection range	0~150 ppm (1 digit: 1 ppm)
Concentration value display	LCD digital display (3 digit 7 segment/3 color backlight: green, orange and red) <sup>*1</sup>
Length of remote cable	3 m, 5 m, 10 m, 20 m
Kind of alarm	Gas alarm: 2 step alarm (fault alarm pattern/cancel with reset switch) Fault alarm: System abnormal, sensor abnormal (non latching (auto-reset))
Alarm setpoint value	1st: 50ppm 2nd: 100ppm
Alarm history record	10 records from the latest (highest concentration and generated date)
External output	4~20 mA DC (non-insulated, load resistance 300 Ω or less) or 0~1 VDC (non-insulated) <sup>*2</sup>
Alarm contact	Dry contact 1a or 1b each, Contact capacity 125 VAC 1 A or 30 VDC 1 A (resistance load)
Range of operating temperature and relative humidity	0~40°C (no sudden change), below 90% RH (non-condensing)
Power supply	100 VAC ±10% 50/60 Hz or 24 VDC ±10% or 2 size AA alkaline battery
Power consumption	AC specification: Max. 5 VA DC specification: Max. 3 W
Continuous operating time (dry battery specification)	approx. 1 year (25°C, without alarm, backlight off)
External dimensions	Main body: approx. 80 (W) × 120 (H) × 35.5 (D) mm Remote sensor: approx. 40 (W) × 96 (H) × 35.5 (D) mm (projection portions excluded)
Weight	AC specifications: approx. 200 g DC specifications: approx. 180 g Dry battery specification: approx. 230 g Remote sensor: approx. 55 g (cable is excluded)



## AC-5

### Features

- Work function and ionization potential can be measured in approx. 5 minutes in the atmosphere.
- A big sample can be measured (max. 180 mm × 180 mm).
- Continuous measurement possible (max. 25 samples at 1 time).
- A new type detector adopted (the measurement of the electron count in 1 second has increased to twice compared to our old detector).
- Range of energy scanning: 3.4 ~ 6.2 eV.
- Max. light intensity: 500 nW or more (at 5.9 eV).



### Specification

Model	AC-5
Measuring principle	Low-energy electron count
Range of energy scanning	3.4~6.2eV (364~200nm)
Repeatability (standard deviation)	Work function 0.02 eV (sample: gold plate) Slope 1.0 Y/eV (averaged slope at 20 ~ 30 Y/eV)
Measuring time	Normal time required to measure the work-function: approx. 5 minutes (5 sec an energy measurement)
Maximum count	4,000cps
UV lamp	D <sub>2</sub> lamp
Min. light intensity	1.0 nW or less (at 5.9 eV)
Max. light intensity	500 nW or more (at 5.9 eV)
Ultraviolet spot size	2~4 mm square
Spectroscope	Grating type monochromator
Sample	approx. 180 mm × 180 mm Max. thickness 1.0 mm ±0.2 mm
Sample stand	For approx. 195 mm × 195 mm Max. thickness 1 mm
Range of operating temperature and relative humidity	15~35°C, dew point -30°C or higher, below 60% RH
Power supply	100~240VAC 50/60Hz 5A (max)
Power consumption	approx. 240 W (personal computer excluded)
External dimensions	AC-5 LC (light source part): approx. 470 (W) × 500 (D) × 300 (H) mm AC-5 DC (metering part): approx. 600 (W) × 500 (D) × 380 (H) mm (neither rubber feet nor projection portions are included)
Weight	AC-5 LC (light source part): approx. 35 kg AC-5 DC (metering part): approx. 50 kg

\* To operate this equipment, a display and manual operating device (personal computer equipment) is required separately.

## Option for photoelectron spectrophotometer Fermi level measuring instrument

## FAC-2

### Features

- Fermi level of the semiconductor sample that was not able to be measured with the photoelectron spectrophotometer can be measured in an atmosphere.
- It is suitable to measure the time elapsing changes in metallic surface, etc. immediately after deposition, because the necessary time to measure is short.
- Set up of the sample is easy, as the precise adjustment of the distance between electrode and sample is unnecessary.



### Specification

Measuring method	Kelvin method
Configuration of Measuring section	φ 10mm
Energy range of measurement	3.4~6.2 eV (when calibrated with a standard sample of the work function 5 eV)
Measuring time	10 seconds or less
Repeated reproducibility	±0.02 eV or less
Range of operating temperature	10~35°C
Range of operating relative humidity	60% RH or less
Power supply	100VAC 50/60Hz
External dimensions	approx. 235 (W) × 330 (H) × 408 (D) mm (standard size. H and D vary depending on the microscope position.)
Weight	approx. 12 kg

## AC-3

### Features

- A comparatively big sample (max. 30 mm square) and powder can be measured because measurement is implemented in the atmosphere.
- Information on the surface up to the depth to the nanometer order can be measured.
- Work function and ionization potential can be measured in approx. 5 minutes.
- Range of energy scanning: 4.0 ~ 7.0 eV.
- Max. light intensity: 100 nW or more (at 5.9 eV).
- Handling is easy as the vacuum is not used.



### Specification

Model	AC-3
Measuring principle	Low-energy electron count
Electron detector	Open counter
Range of energy scanning	4.0~7.0eV (310~177nm)
UV lamp	Heavy hydrogen lamp with lamphouse
Spectroscope	Nitrogen substitution grating type monochromator
Repeatability	Work function 0.02 eV (standard deviation)
Measuring time	Normal time required to measure work function: approx. 5 minutes (10 sec an energy measurement)
Ultraviolet spot size	2x5mm
Max. light intensity	100 nW or more (at 5.9 eV)
Sample	30 x 30 mm (max.), thickness 10 mm (max.), 1 point measurement
Software	AC-3 for Windows (work function meter)
Range of operating temperature and relative humidity	15~35°C, 20~60%RH
Power supply	AC100V 50/60Hz 5A (max)
Utility	Compressed air: Pressure 0.5 ~ 0.7 MPa, flow rate 5 L/min Nitrogen: Pressure 0.5 ~ 0.6 MPa, flow rate 2 L/min (measuring), 5 L/min (purging)
External dimensions	approx. 740 (W) x 1080 (H) x 680 (D) mm (caster included)
Weight	approx. 120 kg

\* To operate this equipment, a display and manual operating device (personal computer equipment) is required separately.

## Portable X-ray Diffractometer with a Fluorescent X-ray Analyzer

## DF-01

### Features

- 2 kinds of analyses of diffraction X rays and X-ray fluorescence can be implemented at the same point, and then more accurate data can be obtained from 2 different measurement data.
- **Nondestructive and noncontact portable analyzer.**  
Analysis method of nondestructive and noncontact.  
The relic and the cultural asset, etc. which are restricted to move and carry out can be "analysed in situ".
- **Measuring object of large-scale and the strange appearance can be measured as it is.**  
There are little restrictions in the nominal size and the shape of the measuring object. It is possible to measure it as it is without fracture, cutting out and/or dividing even if the measuring object is large and/or strange appearance.




### Specification

Model	DF-01
Detection element	$^{13}\text{Al}-_{92}\text{U}$
Specimen geometry	Unrestricted (do not collide with the device)
Atmosphere	Atmosphere and He
Measurement size	over $\phi$ 2.5 mm (differ according to the angle)
Measuring range of angle $2\theta$	0~120°
The least travel	0.002°
Collimator	$\phi$ 2mmx75mm
X-ray tube target	Cr
Rated output of X-ray tube	28W
Rated voltage of X-ray tube	35kV
Rated current of X-ray tube	0.8mA
X-ray tube cooling system	Forced-air cooling
Detector type	Si-PIN photodiode
Power supply	100~240VAC 50/60Hz 5A (max)
External dimensions	Metering section: approx. 542 (W) x 342 (D) x 203 (H) mm (for $2\theta = 0^\circ$ ) Control part: approx. 427 (W) x 295 (D) x 180 (H) mm
Weight	Metering part: approx. 12 kg Control part: approx. 16 kg

\* To operate this equipment, a display and manual operating device (personal computer equipment) is required separately.

# Marine Gas Detection System

- Scanning type gas detection system
  - Pump room/water ballast tank/inter barrier space
  - Other holding

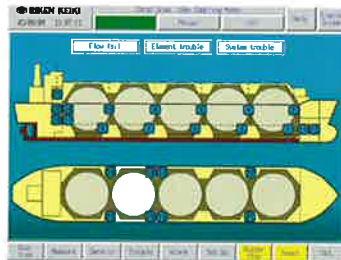

Area screen



List screen



Bar meter screen



Alarm screen

- Touch panel easy to see
- Gas detecting part <--> Display part separated type considering the installing location
- Piping inboard shortening possible
- Built-in ballast water mis-aspiration prevention device (for oil tanker)

## ● Gas detection alarm system for pump room



Operation unit



Display unit

- Model MS PR-2.0 (HC)
- Model MS PR-2.1 (HC/O<sub>2</sub>)
- Model MS PR-2.2 (HC/H<sub>2</sub>S)
- Model MS PR-2.3 (HC/O<sub>2</sub>/H<sub>2</sub>S)

- Covering SOLAS 2000
- Oil tanker pump room dedicated gas detecting alarm system
- 4 to 6 point switching measurement type
- Corresponding to O<sub>2</sub> and H<sub>2</sub>S measurement besides HC gas

## ☐ Danger of Gas


### ☐ What is the Combustible Gas ...?

According to Safety Regulations for General High Pressure Gas (JAPAN), the combustible gas is;

- The lower limit of the explosion limit of it (it means the explosion limit when it is mixed with air. It is the same as follows.) is 10-percent or less.
- The difference between upper limit and lower limit of explosion limit of it is 20 percent or larger.

The combustible gas is a generic name of the gas with the possibility of causing combustion. There is a possibility of causing an explosion if the density range of the mixture of combustible gas and Oxygen (air) is in a certain range and ignition source exists. This density range is called the range of explosion, and the lowest concentration over the range of explosion is called Lower Explosive Limit (LEL) and the highest concentration are called Upper Explosive Limit (UEL).

One Example of Lower Explosive Limit (LEL) and Upper Explosive Limit (UEL) of Hydrogen (H<sub>2</sub>)

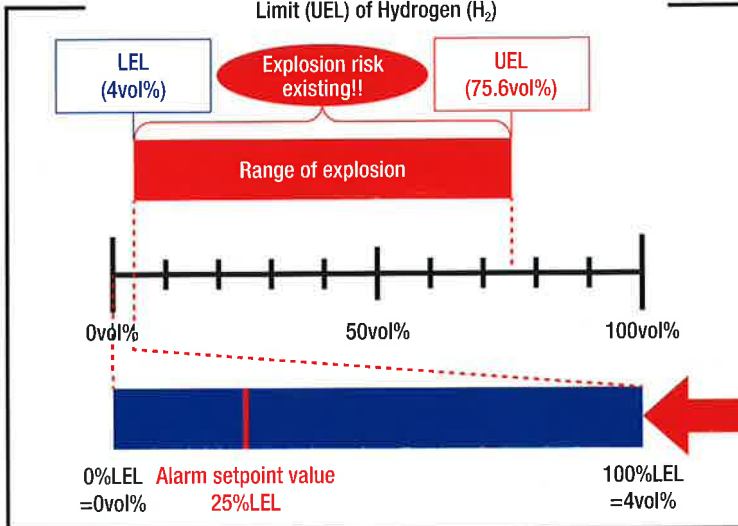

Regarding the Alarm Setpoint Value of the Combustible Gas

It is too late to announce the danger after the concentration of the combustible gas reaches Lower Explosive Limit (LEL)!!



The concentration control to inform the existence of the combustible gas before it reaches LEL is necessary.

Regarding the concentration control of less than the Lower Explosive Limit, the alarm setpoint value of the combustible gas is decided as follows in Exemplified Standards concerning Safety Regulations for General High Pressure Gas.

- The value of 1/4 or less of the Lower Explosive Limit

### ☐ What is the Toxic Gas ...?

According to Safety Regulations for General High Pressure Gas (JAPAN), the toxic gas is,

- Threshold limit value is the one of 200/1,000,000 or less (= permissible level is 200 ppm or less)

Moreover, the alarm setpoint value of the toxic gas, according to Exemplified Standards concerning Safety Regulations for General High Pressure Gas, is

- The value below the permissible level value (twice value of the permissible level concentration value for the one which is difficult to prepare the calibration gas)

#### ● Definition of permissible level

It is a concentration judged for the adverse effect on health not to be seen by almost all workers if the concentration of the toxic substance in air is below this value even if the worker is exposed to the toxic substance on the labor site.

RIKEN KEIKI adopts the threshold limit value of ACGIH (The United States industry hygiene expert meeting: American Conference of Governmental Industrial Hygienists) though the threshold limit value is recommended by ACGIH and Japan Association of Industrial Health.

#### ● Kind of threshold limit value

- TWA (time weighted average): Time-weighted average value of that health problems might not be caused even if exposed repeatedly in the usual work of eight hours per day, 40 hours during the week.
- STEL (short term exposure limit): Limit value of short time exposure 4 times or less a day within 15 minutes and interval of 1h or more, by which no health problems might be caused.
- C (ceiling value): Upper bound that must not be exceeded.





## What are Oxygen Deficiency and the Hydrogen Sulfide Poisoning?

Oxygen Deficiency and the hydrogen sulfide poisoning are provided from Ordinance on Prevention of Oxygen Deficiency, etc. as follows.



- **Oxygen Deficiency** ..... The symptom that occurs because of inhalation of air in the state whose concentration of the atmospheric oxygen is less than 18% is observed.
- **Hydrogen sulfide poisoning** .... The symptom that occurs because of inhalation of air in the state whose concentration of the hydrogen sulfide exceeds 10/1,000,000 (10 ppm) is observed.

**A usual alarm setpoint value is set to 18% according to Ordinance on Prevention of Oxygen Deficiency, etc (JAPAN).**

### Symptom of Oxygen Deficiency

Oxygen concentration (%)	Symptom
20.93	Oxygen concentration of atmosphere.
18	It is necessary to prepare the respiratory protective device such as continuous ventilation, the oxygen concentration measurements in the work environment, and the safety belts though it is a safety threshold. 
16 ~ 12	Increase of pulse and ventilatory frequency, mental concentration decrease, wrong simple calculation, poor precision muscle work, muscular depression, headache, the tinnitus aurium, the evil intention, and nausea appear. 
14 ~ 9	A judgment decrease, a state of exaltation, an unstable mental status, frequent sigh, abnormal tiredness, the state of drunkenness, headache, nausea, vomits, no memory at that time, pain in the wound not felt, escape power of whole body, temperature elevation, cyanosis, haze consideration, danger of the crash death from stairs and a ladder and drowning. 
10 ~ 6	Nausea, vomitus, loose freedom of the action, cannot move nor shout even if danger is felt, prostration, sensory hallucination, cyanosis, loss of consciousness, fainting, central nervous system disorder, generalized convulsion, crisis of death. 
6 or less	Several-time gasping respirations and syncope, fainting, bradypnea and stop, spasm, cardioplegic arrest, death.

### Symptom of Hydrogen Sulfide Poisoning

Hydrogen sulfide concentration (ppm)	Symptom
0.025	Limitation of sense of smell,
0.2	Everyone can perceive the odour.
3 ~ 5	Odour of strength of revolted medium degree,
10	Mucous membrane stimulation thresholds of eyes.
20 ~ 30	Do not feel the strength in a concentration any more by the experience of the odour. Minimum boundary where lungs are stimulated.
100 ~ 300	It comes to be felt that the unpleasant odour decreased rather in 2 to 15 minute due to sense of smell neuroparalysis. Diaphragma flame (gas eyes), itching of eye, soreness, feeling that sand catches one's eye, dazling, hyperemia and tumescence, turbidity of diaphragma, cornea fracture and sluff, distortion of view or bleariness, enhancement of soreness by light. Dead from suffocation due to bronchitis, pulmonitis and pulmonary oedema with 8 to 48 hrs. continuum exposure. Scorching soreness of mucous membrane of the air passages. Limitation that doesn't arrive at a serious symptom with an exposure of 1 hr. or less. 
350 ~ 600	Danger of the life with an exposure of 30 minutes to 1 hr.
700 ~ 1000	Respiratory paralysis, loss of consciousness, fainting, respiratory stoppage, and death at once after appearance of short time interval breath.
5,000	Instantaneous death. 

Reference : New anoxia danger work chief person text (October 26, 2007 3rd print issued)

## List of Combustible Gas to be Detected<sup>※</sup>

Gas name	Chemical formula	Flash point (°C)	Ignition temperature (°C)	Explosion limit (vol%)		Specific gravity
				Lower limit	Upper limit	
Acetylene	C <sub>2</sub> H <sub>2</sub>	gas	305	1.5	100	0.9 (gas)
Acetone	C <sub>3</sub> H <sub>6</sub> O	-20	539	2.15	14.3 100°C	0.8
Isobutane	C <sub>4</sub> H <sub>10</sub>	gas	460	1.8	9.8	0.6
Ethanol	C <sub>2</sub> H <sub>6</sub> O	12	400	3.3	19	0.8
Ethane	C <sub>2</sub> H <sub>6</sub>	gas	515	3.0	15.5	1.0 (gas)
Ethylene	C <sub>2</sub> H <sub>4</sub>	gas	440	2.7	36.0	1.0 (gas)
Ortho-xylene	C <sub>8</sub> H <sub>10</sub>	30	470	1.0	7.6	0.9
Ethyl acetate	C <sub>4</sub> H <sub>8</sub> O <sub>2</sub>	-4	470	2.1	12.8	0.9
Cyclohexane	C <sub>6</sub> H <sub>12</sub>	-17	245	1.3	8.3	0.8
Cyclopentane	C <sub>5</sub> H <sub>10</sub>	-37	320	1.4	—	—
Dimethyl ether	C <sub>2</sub> H <sub>6</sub> O	gas	240	3.0	32	—
Hydrogen	H <sub>2</sub>	gas	560	4.0	75	0.07 (gas)
Styrene	C <sub>8</sub> H <sub>8</sub>	30	490	1.1	8.0	0.9
Tetrahydrofuran	C <sub>4</sub> H <sub>8</sub> O	-14	230	1.8	12.4	0.9
Toluene	C <sub>7</sub> H <sub>8</sub>	4	530	1.2	7.8	0.9
1,3-butadiene	C <sub>4</sub> H <sub>6</sub>	gas	420	1.1	16.3	0.6
Propane	C <sub>3</sub> H <sub>8</sub>	gas	450	2.0	10.9	1.6 (gas)
Propylene	C <sub>3</sub> H <sub>6</sub>	gas	455	2.0	11.1	—
n-hexane	C <sub>6</sub> H <sub>14</sub>	-22	223	1.2	7.5	0.7
n-heptane	C <sub>7</sub> H <sub>16</sub>	-7	204	1.1	6.7	0.7
Benzene	C <sub>6</sub> H <sub>6</sub>	-11	498	1.2	8.6	0.9
Methyl methacrylate	C <sub>5</sub> H <sub>8</sub> O <sub>2</sub>	10	430	1.7	12.5	0.9
Methanol	CH <sub>3</sub> O	9	440	5.5	36	0.8
Methane	CH <sub>4</sub>	gas	600	5.0	15.0	0.6
Methyl isobutyl ketone	C <sub>6</sub> H <sub>12</sub> O	16	475	1.2 90°C	8 90°C	0.8



※ The value of each item is different according to the literature. The explosion limit in this list of gas to be detected is described based on the house standard. The flash point and the ignition temperature is according to [Technological indicator of Labor health and safety General Institute: JNIOHS-TR-No.44 (2012) Factory explosion-proof facility guide for user] and the specific gravity is according to [Danger and harmful handbook of chemical substance, June 20, 1991, 1st ed 1st print issued]

## List of Toxic Gas to be Detected

Gas name	Chemical formula	ACGIH recommendation value			Japan Association of Industrial Health recommendation value	RIKEN KEIKI standard	
		Threshold limit value (TLV) <sup>※1</sup>				Threshold limit value <sup>※1</sup>	Detection range <sup>※2</sup>
		TWA	STEL	C			
Arsine	AsH <sub>3</sub>	5ppb	—	—	10ppb	0~15ppb	5ppb
Phosphine	PH <sub>3</sub>	0.3ppm	1ppm	—	0.3ppm	0~1ppm	0.3ppm
Diborane	B <sub>2</sub> H <sub>6</sub>	0.1ppm	—	—	0.01ppm	0~0.3ppm	0.1ppm
Silane	SiH <sub>4</sub>	5ppm	—	—	100ppm	0~15ppm	5ppm
Disilane	Si <sub>2</sub> H <sub>6</sub>	—	—	—	—	0~15ppm	5ppm
Germane	GeH <sub>4</sub>	0.2ppm	—	—	—	0~0.8ppm	0.2ppm
Hydrogen selenide	H <sub>2</sub> Se	0.05ppm	—	—	0.05ppm	0~0.2ppm	0.05ppm
Nitrogen trifluoride	NF <sub>3</sub>	10ppm	—	—	—	0~30ppm	10ppm
Boron tribromide	BBr <sub>3</sub>	—	—	1ppm	—	HBr 0~6ppm	HBr 2ppm
Arsenic trichloride	AsCl <sub>3</sub>	—	—	—	—	HCl 0~6ppm	HCl 2ppm
Arsenic pentachloride	AsCl <sub>5</sub>	—	—	—	—	HCl 0~6ppm	HCl 2ppm
Boron trichloride	BCL <sub>3</sub>	—	—	—	—	HCl 0~6ppm	HCl 2ppm
Germanium tetrachloride	GeCL <sub>4</sub>	—	—	—	—	HCl 0~6ppm	HCl 2ppm
Molybdenum pentachloride	MoCL <sub>5</sub>	—	—	—	—	HCl 0~6ppm	HCl 2ppm
Phosphorus trichloride	PCL <sub>3</sub>	0.2ppm	0.5ppm	—	0.2ppm	HCl 0~6ppm	HCl 2ppm
Phosphorus pentachloride	PCL <sub>5</sub>	0.1ppm	—	—	0.1ppm	HCl 0~6ppm	HCl 2ppm
Phosphorus oxychloride	POCL <sub>3</sub>	0.1ppm	—	—	—	HCl 0~6ppm	HCl 2ppm
Antimony pentachloride	SbCL <sub>5</sub>	—	—	—	—	HCl 0~6ppm	HCl 2ppm
Silicon tetrachloride	SiCL <sub>4</sub>	—	—	—	—	HCl 0~6ppm	HCl 2ppm
Dichlorosilane	SiH <sub>2</sub> CL <sub>2</sub>	—	—	—	—	HCl 0~6ppm	HCl 2ppm
Trichlorosilane	SiHCL <sub>3</sub>	—	—	—	—	HCl 0~6ppm	HCl 2ppm
Tin tetrachloride	SnCL <sub>4</sub>	—	—	—	—	HCl 0~6ppm	HCl 2ppm
Tungsten hexachloride	WCL <sub>6</sub>	—	—	—	—	HCl 0~6ppm	HCl 2ppm
Tungsten hexafluoride	WF <sub>6</sub>	—	—	—	—	HF 0.4ppm~3ppm	HF 0.5ppm
Arsenic trifluoride	AsF <sub>3</sub>	—	—	—	—	HF 0.4ppm~3ppm	HF 0.5ppm
Arsenic pentafluoride	AsF <sub>5</sub>	—	—	—	—	HF 0.4ppm~3ppm	HF 0.5ppm
Boron trifluoride	BF <sub>3</sub>	—	—	1ppm	0.3ppm	HF 0.4ppm~3ppm	HF 0.5ppm
Molybdenum hexafluoride	MoF <sub>6</sub>	—	—	—	—	HF 0.4ppm~3ppm	HF 0.5ppm
Phosphorus pentafluoride	PF <sub>5</sub>	—	—	—	—	HF 0.4ppm~3ppm	HF 0.5ppm
Sulfur tetrafluoride	SF <sub>4</sub>	—	—	0.1ppm	—	HF 0.4ppm~3ppm	HF 0.5ppm
Silicon Tetrafluoride	SiF <sub>4</sub>	—	—	—	—	HF 0.4ppm~3ppm	HF 0.5ppm
Hydrogen chloride	HCL	—	—	2ppm	5ppm	0~6ppm	2ppm
Hydrogen fluoride	HF	0.5ppm	—	2ppm	3ppm	HF 0.4ppm~3ppm	HF 0.5ppm
Hydrogen bromide	HBr	—	—	2ppm	—	0~6ppm	2ppm
Hydrogen iodide	HI	—	—	—	—	0~5ppm	2ppm
Chlorine	CL <sub>2</sub>	0.5ppm	1ppm	—	0.5ppm	0~1.5ppm	0.5ppm
Fluorine	F <sub>2</sub>	1ppm	2ppm	—	—	0~3ppm	1ppm
Bromide	Br <sub>2</sub>	0.1ppm	0.2ppm	—	0.1ppm	0~1ppm	0.2ppm
Chlorine trifluoride	CLF <sub>3</sub>	—	—	0.1ppm	—	0~0.6ppm	0.1ppm
Ozone	O <sub>3</sub>	0.1ppm	—	—	0.1ppm	0~0.6ppm	0.1ppm
Nitrogen monoxide	NO	25ppm	—	—	—	0~100ppm	25ppm
Nitrogen dioxide	NO <sub>2</sub>	0.2ppm	—	—	pending	0~9ppm	3ppm
Sulfur dioxide	SO <sub>2</sub>	—	0.25ppm	—	pending	0~6ppm	2ppm/4ppm
Hydrogen sulfide	H <sub>2</sub> S	1ppm	5ppm	—	5ppm	0~3ppm	1ppm
Carbon monoxide	CO	25ppm	—	—	50ppm	0~75ppm	25ppm
Ammonia	NH <sub>3</sub>	25ppm	35ppm	—	25ppm	0~75ppm	25ppm
Monomethylamine (MMA)	CH <sub>5</sub> N	5ppm	15ppm	—	10ppm	0~15ppm	5ppm
Dimethylamine (DMA)	C <sub>2</sub> H <sub>7</sub> N	5ppm	15ppm	—	10ppm	0.2~15ppm	5ppm
Trimethylamine (TMA)	C <sub>3</sub> H <sub>9</sub> N	5ppm	15ppm	—	—	0~15ppm	5ppm
Diethylamine (DEA)	C <sub>4</sub> H <sub>11</sub> N	5ppm	15ppm	—	10ppm	0.2~15ppm	5ppm
Hydrogen cyanide	HCN	—	—	4.7ppm	5ppm	0.3~15ppm	5ppm
Hydrogen peroxide	H <sub>2</sub> O <sub>2</sub>	1ppm	—	—	—	0~3ppm	1ppm/2ppm

※1 Refer to [2013 TLVs R and BEIs R] for the threshold limit value recommended by ACGIH (American Conference of Governmental Industrial Hygienist).  
Refer to [Industrial hygiene magazine Journal of Occupational Health Vol 55 No. 5 Issue September, 2013] for the threshold limit value recommended by Japan Association of Industrial Health.  
RIKEN KEIKI adopts the threshold limit value of ACGIH.

※2 For the hydrolyzing gas, the range of detection and the alarm setpoint value of the gas generated after the gas is hydrolyzed are described.  
TWA (time weighted average): Time-weighted average value of that health problems might not be caused even if exposed repeatedly in the usual work of 8 hours per day, 40 hours during the week.  
STEL (short term exposure limit): Limit value of short time exposure 4 times or less a day within 15 minutes and interval of 1h or more, by which no health problems might be caused.  
C (ceiling value): Upper bound that must not be exceeded.

# Related Laws and Regulations (JAPAN)

In the work environments where combustible gases, toxic gases and other hazardous gases are used, it is mandatory to install gas detector to measure them in order to secure safety. This section provides excerpt of the laws and regulations relating to gas detector.

## **High Pressure Gas Safety Act** **(act no. 204 of June 7, 1951)**

**Latest Amendments: Act No. 72 of June 18, 2014**

### Chapter I General Provisions

#### Article 1 (purpose)

The purpose of this Act is to regulate the production, storage, sale, transportation and other matters related to the handling of high pressure gases, their consumption as well as the manufacture and handling of their containers and to encourage voluntary activities by private businesses and the High Pressure Gas Safety Institute of Japan for the safety of high pressure gases with the aim of securing public safety by preventing accidents and disasters caused by high pressure gases.

#### Article 2 (definitions)

The term "high pressure gas" as used in this Act means any gas that falls under any of the following items:

- (i) Compressed gas, the pressure (meaning gauge; the same shall apply hereinafter) of which is not less than 1 megapascal at its normal operating temperature and which is currently not less than 1 megapascal, or compressed gas, the pressure of which is not less than 1 megapascal at a temperature of 35 degrees Celsius (except compressed acetylene gas in both cases);
- (ii) Compressed acetylene gas, the pressure of which is not less than 0.2 megapascal at its normal operating temperature and which is currently not less than 0.2 megapascal, or compressed acetylene gas, the pressure of which is not less than 0.2 megapascal at a temperature of 15 degrees Celsius;
- (iii) Liquefied gas, the pressure of which is not less than 0.2 megapascal at its normal operating temperature and which is currently not less than 0.2 megapascal, or liquefied gas, the temperature of which is 35 degrees Celsius or less in the case that the pressure is 0.2 megapascal; or
- (iv) In addition to what is listed in the preceding item, those liquefied gases, the pressure of which exceeds zero Pascal at a temperature of 35 degrees Celsius, and which, inclusive of liquefied hydrogen cyanide and liquefied methyl-bromide, are specified by a Cabinet Order.

## **Cabinet Order of High Pressure Gas Safety Act** **(cabinet order no. 20 of February 19, 1997)**

**Latest Amendments: Cabinet Order No. 326 of October 27, 2004**

The Cabinet establishes this Order in accordance with the provisions of the High Pressure Gas Safety Act (act no. 204 of 1951) and for implementation thereof.

#### Article 7 (type of high pressure gas specified in cabinet order)

The types of gases, among those high pressure gases of Paragraph 1 of Article 24-2 of the Act, specifically specified in a Cabinet Order as requiring special care for the prevention of accidents in their consumption shall be the following gases in compressed and liquefied form:

- (i) silane
- (ii) phosphine
- (iii) arsine
- (iv) diborane
- (v) hydrogen selenide
- (vi) monogermene
- (vii) disilene

## **Safety Regulations for General High Pressure Gas** **(ministry of international trade and industry ordinance no. 53 of May 25, 1966)**

**Latest Amendments: Ministry of Economy, Trade and Industry Ordinance No. 58 of November 20, 2014**

### Chapter I General Provisions

#### Article 1 (scope)

This is set forth, based on the High Pressure Gas Safety Act (act no. 204 of 1951, hereinafter referred to as the "Act"), the regulations on the safety (excluding the safety on the production of high pressure gases pertaining to the specific production businesses specified in the Safety Regulations for Industrial Complex, etc. (ministry of international trade and industry ordinance no. 88 of 1986)) on the high pressure gases (excluding high pressure gases subject to the provisions of Regulations for Refrigeration Safety (ministry of international trade and industry ordinance no. 51 of 1966) and Safety Regulations for Liquefied Petroleum Gas (ministry of international trade and industry ordinance no. 52 of 1966): the same shall apply hereinafter).

#### Article 2 (definitions)

For the purpose of these regulations, the terms listed in the following items shall be defined as follows:

- (i) "combustible gases" shall mean: acrylonitrile, acrolein, acetylene, acetaldehyde, arsine, ammonia, carbon monoxide, ethane, ethylamine, ethyl benzene, ethylene, ethyl chloride, vinyl

chloride, chloromethyl, ethylene oxide, propylene oxide, hydrogen cyanide, cyclopropane, disilene, diborane, dimethylamine, hydrogen, hydrogen selenide, trimethylamine, carbon disulfide, butadiene, butane, butylene, propane, propylene, bromomethyl, benzene, phosphine, methane, monogermene, silane, monomethylamine, methyl ether, hydrogen sulfide and other gases falling under either of the following a. or b.

- a. The lower explosion limit (meaning the explosion limit when mixed with air: the same shall apply hereinafter) being 10% or less
  - b. The difference between the upper limit and lower explosion limit being 20% or more
- (ii) "toxic gases" shall mean: acrylonitrile, acrolein, sulfuric acid gas, arsine, ammonia, carbon monoxide, chlorine, chloromethyl, chloroprene, arsenic pentafluoride, phosphorus pentafluoride, ethylene oxide, nitrogen trifluoride, boron trifluoride, phosphorus trifluoride, hydrogen cyanide, diethylamine, disilene, sulfur tetrafluoride, silicon tetrafluoride, diborane, hydrogen selenide, trimethylamine, carbon disulfide, fluorine, bromomethyl, benzene, phosgene, phosphine, monogermene, silane, monomethylamine, hydrogen sulfide and other gases with threshold limit value being 200 ppm or less.
  - (iii) "special high pressure gases" shall mean: arsine, disilene, diborane, hydrogen selenide, phosphine, monogermene and silane.
  - (iv) "inert gases" shall mean: helium, neon, argon, krypton, xenon, radon, nitrogen, carbon dioxide or fluorocarbon (excluding combustible type).

### Chapter II Permission, etc. concerning Production or Storage of High Pressure Gas Section 1 Permission, etc. concerning Production of High Pressure Gas

#### Article 6 (technical standards concerning stationary production equipment)

Technical standards specified by an Ordinance of METI as referred to in Article 8, item (1) of the Act for the production facilities made up of stationary production equipment (excluding cold evaporator, compressed natural gas station, liquefied natural gas station and compressed hydrogen station) shall be as follows, provided, however, that this shall not apply in case of taking any safety measure which is approved by the Minister of Economy, Trade and Industry as having an equivalent effect, and refrigerating equipment for cooling of production equipment may be subject to the technical standards specified by the Regulations for Refrigeration Safety.

- (xxvi) Electrical equipment concerning high pressure gas equipment for combustible gases (excluding ammonia and bromomethyl) shall be of a structure having explosion-proof capabilities suitable for its installation place and the type of the gas.
- (xxvii) Production facilities of combustible gases or toxic gases specified by the Minister of Economy, Trade and Industry shall be installed with equipment to detect leak of such gases and trigger an alarm at places where gases leaked from such production facilities may accumulate.
- (xxviii) Piping concerning gas equipment for special high-pressure gas, arsenic pentafluoride, etc., sulfuric acid gas, ammonia, chlorine, chloromethyl, ethylene oxide, hydrogen cyanide, phosgene or hydrogen sulfide shall, wherever necessary, of double tube construction depending on the type, properties and pressure of these gases as well as on the nearby situation of the piping (including the concentrated condition of type 1 safety properties and type 2 safety properties in the vicinity of the business where the piping is installed), and necessary measures shall be taken to detect the leakage of the gas from such double tube, provided, however, that this shall not apply if the piping is prevented from being damaged by installing in a sheath or other protective structure and measures are taken to prevent any leaked gas from spreading to the vicinity.

### Chapter VIII Notification concerning Consumption of High Pressure Gas

#### Article 55 (technical standards concerning consumers of specific high pressure gas)

Technical standards specified by an Ordinance of METI as referred to in Paragraph 1 of Article 24-3 of the Act shall be as follows.

- (xxiv) Piping concerning consumption equipment for special high-pressure gas, liquefied ammonia or liquefied chloride shall, wherever necessary, of double tube construction depending on the type, properties and pressure of these gases as well as on the nearby situation of the piping (including the concentrated condition of type 1 safety properties and type 2 safety properties in the vicinity of the business where the piping is installed), and necessary measures shall be taken to detect the leakage of the gas from such double tube, provided, however, that this shall not apply if the piping is prevented from being damaged by installing in a sheath or other protective structure and measures are taken to prevent any leaked gas from spreading to the vicinity.
- (xxv) Consumption facilities shall be installed with equipment to detect leak of such gases and trigger an alarm at places where gases leaked from such production facilities may accumulate.

## **Exemplified Standards concerning Safety Regulations for General High Pressure Gas**

**(enacted on March 26, 2001, amended on December 26, 2012)**

### 23. Gas leakage detection and alarm equipment and place of installation Relevant provisions

Article 6 paragraph 1 item (xxvi), Article 7 paragraph 1 item (i), Article 7-3 paragraph 1 item (vii), paragraph 2 item (xvi), Article 12 paragraph 1 item (i), Article 22, Article 55 paragraph 1 item (xxvi)

Equipment to detect and trigger an alarm of any leakage of combustible gases and toxic gases (acrylonitrile, sulfuric acid gas, arsine, ammonia, carbon monoxide, chlorine, ethylene oxide, disilene, diborane, hydrogen selenide, carbon disulfide, benzene, phosphine, monogermene, silane and hydrogen sulfide) at production facilities, storage places and consumption facilities shall be in accordance with the following standards.

#### 1. Function

Gas leakage detection and alarm equipment (hereinafter referred to as "Detection alarm

# Related Laws and Regulations (JAPAN)

equipment" in 23 of these Standards) shall be capable of detecting leakage of combustible gases or oxygen or toxic gases, indicating its concentration as well as triggering an alarm and shall have the following capabilities.

- 1.1 Detection alarm equipment shall be of catalytic combustion method, membrane type galvanic cell method, semi-conductor method or any other method to automatically trigger an alarm at the preset gas concentration (hereinafter referred to as "Alarm setpoint") by detecting the change of detection element by an electrical mechanism.
- 1.2 Alarm setpoint shall be a quarter or less of a lower explosive limit for combustible gases, 25% for oxygen and acceptable concentration (twice the value of acceptable concentration for ammonia, chlorine and other toxic gases similar thereto with difficulty to prepare the calibration gas; the same shall apply to 1.6) or less for toxic gases, provided, however, that it shall be 0.1% or less for the Detection alarm equipment to be installed pursuant to 3.1 (6) c. In this case, Alarm setpoint shall be able to be set at any value.
- 1.3 The gas alarm accuracy of Detection alarm equipment shall be  $\pm 25\%$  or less for combustible gases,  $\pm 5\%$  or less for oxygen and  $\pm 30\%$  or less for toxic gases of the Alarm setpoint.
- 1.4 The delay time for the Detection alarm equipment to trigger an alarm shall be inspected by applying the alarm delay test under the provision 6.7.2 of JIS M7626 (1994) correspondingly. This inspection shall be conducted by introducing the gas 1.6 times of the concentration of the Alarm setpoint and the delay then shall be within 30 seconds, provided, however, that it shall be within one minute for specific gases which delay more than that for the structure of the Detection alarm equipment or for theoretical reasons (ammonia, carbon monoxide or any other gases equivalent thereto).
- 1.5 Alarm accuracy shall not deteriorate even when there are  $\pm 10\%$  fluctuations of power voltage, etc.
- 1.6 The scale of indicator shall, within each scale range, clearly indicate 0 to lower explosive limit (for those with the Alarm setpoint being low concentration, proper value of the lower explosive limit or less can be set in consideration of such Alarm setpoint), 0 to 50% for oxygen and 0 to three times the value of acceptable concentration for toxic gases.
- 1.7 Once an alarm is triggered, the alarm shall, in principle, continue even upon the change of gas concentration in the atmosphere and shall stop only by its inspection or measures to be taken.
- 1.8 Detection alarm equipment shall be regularly maintained in accordance with maintenance particulars described in instruction manuals or specifications. The results of maintenance shall also be recorded and retained for three years or more.
- 1.9 Calibration of the reading of gas leakage detection alarm equipment for special high-pressure gas shall be carried out at least once every six months.
- 1.10 Detection alarm equipment shall be checked at least once a month for triggering of an alarm upon the alarm circuit inspection and at least once a year for the proper operation by the detection and alarm inspection.

## 2. Construction

The construction of Detection alarm equipment shall be as follows.

- 2.1 It shall have sufficient strength (element and transmission circuit being particularly durable) and shall be easy to handle and maintain (particularly for the replacement of element, etc.)
- 2.2 The parts which come into contact with gases shall be made of corrosion-resistant materials or materials with sufficient anticorrosion treatment and other parts shall be finished with good coating or plating.
- 2.3 For explosion proof property, it shall have passed the test under Article 44 of Industrial Safety and Health Act (act no. 57 of 1972).
- 2.4 In the case of receiving alarms from two or more probes, receiving circuit shall be able to trigger an alarm if it is under the condition to activate the Detection alarm equipment and such point shall be identifiable even when the other triggers an alarm and activate the circuit.
- 2.5 Receiving circuit shall be made easily identifiable of it being activated.
- 2.6 Alarm shall trigger an alarm simultaneously with turning on or blinking of a lamp.

## 3. Installation place

Detection alarm equipment shall be installed as follows.

- 3.1 Installation place and quantity of probes of Detection alarm equipment in the production facilities (excluding piping: the same shall apply hereinafter in 3.1) shall be in accordance with the following items:
  - (1) In the circumference of a place where there are indoor-installed compressor, pump, reaction equipment, storage tank and other high-pressure gas equipment with high potential for gas leakage (excluding those specified in (3)) and where leaked gas is likely to accumulate: One or more per 10 meter circumference of these equipment group;
  - (2) If those high-pressure gas equipment as referred to in (1) are installed outdoor and are close to other high-pressure equipment, walls or other structures, or are installed inside a pit or the like, a place where leaked gas is likely to accumulate: One or more per 20 meter circumference of these equipment group;
  - (3) A place where leaked gas is likely to be accumulated in the circumference of production facilities including fire source such as a heating furnace: The number calculated by the ratio of one or more per 20 meter circumference of the place;
  - (4) Inside an instrument room (excluding the case where measure(note) is taken to prevent penetration of leaked gas): One or more;
  - (5) In the circumference of a group of filling ports of toxic gases: One or more; (note) In principle, the measure to prevent penetration of leaked gas shall mean either of the following:
    - a. To retain the pressure inside the instrument room necessary for preventing penetration of gases from outside; or
    - b. To raise the entrance floor to at least 2.5 meters over the ground for the instrument room only for gases heavier than air.
  - (6) Notwithstanding the foregoing (1) to (5), the following standards shall apply to specific compressed hydrogen stations of Article 7-3, Paragraph 2:
    - a. One or more inside a steel casing or inside a fireproof room in which compressor is installed, provided, however, that for such fireproof room of which inside wall dimension exceeds 10 meters, the quantity shall be one or more for every 10 meters in such length;
    - b. One or more inside the dispenser case;
    - c. One each or more of Detection alarm equipment having one or more probes near the connection part such as the coupling between the filling hose and the container fixed

onto a vehicle (see Fig.1);

- d. One or more on the upper piping module of accumulator (see Fig.2);
  - e. One or more at a place where hydrogen is accumulated near the device to generate hydrogen such as a reformer.
- 3.2 Installation place and quantity of probes for Detection alarm equipment in a repository or consumption facilities (excluding piping; the same shall apply hereinafter in 3.2) shall be in accordance with the following items:
    - (1) In the circumference of a place where there are indoor-installed decompression equipment, storage equipment, consumption equipment (excluding part of burners, etc. which are equipped with an interlocking mechanism of pilot burner method and not likely to cause gas leakage) and other equipment with high potential for gas leakage and where leaked gas is likely to accumulate: One or more per 10 meters of the circumference of these equipment group;
    - (2) If those equipment as referred to in (1) are installed outdoor and are close to other equipment, walls or other structures, or are installed inside a pit or the like, a place where leaked gas is likely to accumulate: One or more per 20 meter circumference of these equipment group;
    - (3) If containers for special high-pressure gas, etc. are stored at a container depot: One or more in the circumference of a place of the container group where leaked gas is likely to accumulate;
    - (4) Inside a cylinder cabinet: One or more.
  - 3.3 The height for the probe to be installed for the facilities of 3.1 or 3.2 shall be determined in accordance with conditions such as specific gravity of the gas, environment, height of gas equipment and so on.
  - 3.4 A place where alarm is triggered and lamp is turned on or blinks shall be where parties concerned are stationed and is suitable for taking various countermeasures upon an alarm.
  - 3.5 In cases where forced exhaust equipment is operated around the clock in production or consumption facilities, the provisions of 3.1 and (1), (2), (3) of 3.2 shall not apply and a probe shall be installed for every inlet of forced exhaust equipment.




Fig 1 Example of installation near the Connection like a Coupling




Fig 2 Example of Installation at Piping Module of Accumulators, etc.

## 27. Double tube for toxic gas piping

### Relevant provisions

Article 6 paragraph 1 item (xxvii), Article 12 paragraph 1 item (i), Article 22, Article 55 paragraph 1 item (xxiv)

With regard to double tube construction for gas equipment piping of special high-pressure gas, arsenic pentafluoride, etc., sulfurous acid gas, ammonia, chlorine, chloromethyl, ethylene oxide, hydrogen cyanide, phosgene and hydrogen sulfide, the following items shall apply:

1. Outer tube of the double tube construction shall have the standard inside diameter of 1.2 times or more of the outside diameter of the inner tube and material, wall thickness, etc. shall conform to the specifications under 7. Breakdown test and airtightness test, 8. Strength of high-pressure gas equipment and conduit, and 9. Standards of materials used for gas equipment, etc.
2. Any of the following measures shall be taken between the inside tube and outside tube of the double tube to detect leakage of gases:
  - 2.1 To install a probe of gas leakage detection and alarm equipment between the inside tube and outside tube of the double tube;
  - 2.2 To install a device to detect and alarm the rise of pressure between the inside tube and outside tube of the double tube;
  - 2.3 To run inert gas such as nitrogen all the time between the inside tube and outside tube of the double tube, and to install a probe of gas leakage detection alarm equipment on its outlet; or
  - 2.4 To suction between the inside tube and outside tube of the double tube all the time by exhaust equipment, etc. and to install a probe of gas leakage detection alarm equipment on its outlet.

## Industrial Safety and Health Act (act no. 57 of June 8, 1972)

**Latest Amendments: Act No. 82 of June 25, 2014**

### Chapter I General Provisions

#### Article 1 (purpose)

The purpose of this Act is to secure, in conjunction with the Labor Standards Act (act no. 49 of 1947), the safety and health of workers in workplaces, as well as to facilitate the establishment of comfortable working environment, by promoting comprehensive and systematic countermeasures concerning the prevention of industrial accidents, such as taking measures for the establishment of standards for hazard prevention, clarifying the safety and health management responsibility and the promotion of voluntary activities with a view to preventing industrial accidents

### Chapter IV Measures for Preventing the Dangers or Health Impairment of Workers

#### Article 20 (measures to be taken by employers, etc.)

The employer shall take necessary measures for preventing the following dangers:



# Related Laws and Regulations (JAPAN)

- (i) Dangers due to machines, instruments and other equipment (hereinafter referred to as "machines, etc.")
- (ii) Dangers due to substances of an explosive nature, substances of a combustible nature and substances of an combustible nature
- (iii) Dangers due to electricity, heat and other energy

## Chapter V Regulations concerning Machines, etc. and Harmful Substances Section 1 Regulations concerning Machines

### Article 42 (restrictions on transfer, etc.)

Among machines, etc., other than specified machines, etc., which are listed in Appended Table 2, or require dangerous or harmful operations, or are used in a dangerous place, or used for preventing danger or health impairment, those defined by Cabinet Order shall not be transferred, leased or installed unless they conform to the construction code provided for by the Minister of Health, Labour and Welfare or are equipped with safety apparatus designated by the Minister of Health, Labour and Welfare.

### Article 44-2 (type examination)

Of the machines, etc. as referred to in Article 42, one who has manufactured or imported a machine which is listed in Appended Table 4 and designated by the Cabinet Order shall have such manufactured or imported machine undergo the type examination to be conducted by the party registered by the Minister of Health, Labour and Welfare (hereinafter referred to as the "registered type examination agency") as prescribed by the Ordinance of the Ministry of Health, Labour and Welfare. However this provision shall not apply to the machines, etc., which have been imported, and which have undergone the examination set forth in the next paragraph.

## Ordinance on Industrial Safety and Health

(ministry of labour ordinance no. 32 of September 30, 1972)

Latest Amendments: Ministry of Health, Labour and Welfare Ordinance  
No. 132 of December 1, 2014

### Part II Safety Standards

#### Chapter VI Prevention of Dangers in Excavating Work, etc.

##### Section 2 Construction Work of Tunnels, etc.

###### Subsection 1 Investigation, etc.

###### Article 382-2 (measurement, etc. of the concentration of combustible Gas)

The employer shall, in the case of a construction work of tunnels, etc., the combustible gases are liable to be generated, designate a person charged with the measurement of the concentration of the combustible gases in order to prevent an explosion or fire and have the said person measure and record the concentration of the combustible gas at the places where the said combustible gases are liable to be generated or stagnate, every day before commencing the work for the day, after an earthquake of medium shock or heavier or when having found any abnormalities related to the said combustible gases.

###### Article 382-3 (installation, etc. of automatic alarms)

The employer shall, when it is found as a result of the measurement set forth in the preceding Article that the combustible gases exist and is liable to cause an explosion or fire, install automatic alarms at necessary places for an early detection of abnormal rise in the concentration of the combustible gases. In this case, the said automatic alarms shall have system, which is able to quickly alert workers who are working around the area of the detector heads of the automatic alarms to the abnormal rises in the concentration of the said combustible gas.

2. The employer shall, as regards the automatic alarm device set forth in the preceding paragraph, check the following matters before commencing the work for the day, and immediately repair when having found any abnormalities:

- (i) Abnormalities in the measuring gauges
- (ii) Abnormalities in detector heads
- (iii) Function of the alarms

###### Subsection 1-3 Prevention of Explosions, Fires, etc.

###### Article 389-2 (measures in the case of automatic alarms sound)

The employer shall establish measures in advance that the workers concerned should take to prevent an explosion or fire due to combustible gas when the automatic alarms set forth in Article 382-3 sound, and make the said measures known to the said workers.

### Part III Health Standards

#### Chapter I Harmful Working Environment

##### Article 583 (standards of concentration of carbon dioxide gas in a pit)

The employer shall ensure that the concentration of carbon dioxide gas in the air is kept at 1.5% or less in workshop in pits. However, this shall not apply to lifesaving or danger prevention work using air respirators, oxygen respirators or hose masks.

##### Article 589 (workplace to be measured for work environment)

The workshops in pits prescribed by the Ordinance of the Ministry of Health, Labour and Welfare set forth in item (iv) of Article 21 of the Order shall be as follows:

- (i) Workshops in pits where carbon dioxide gas stagnates or is liable to stagnate;
- (ii) Workplace in a pit where temperature exceeds or is likely to exceed 28°C;
- (iii) Workshops in pits provided with ventilation facilities.

##### Article 592 (measurement, etc., of concentration of carbon dioxide gas in a pit)

The employer shall, as regards a workshop in pit set forth in item (i) of Article 589, measure concentration of carbon dioxide gas, periodically once every period within a month.

2. The provisions of paragraph (2) of Article 590 shall apply mutatis mutandis to the case that measurements pursuant to the provision of the preceding paragraph have been carried out.

## Ordinance on Prevention of Anoxia, etc.

(ministry of labour ordinance no. 42 of September 30, 1972)

Latest Amendments: Ministry of Health, Labour and Welfare Ordinance  
No. 175 of December 19, 2003

In accordance with the provisions of Industrial Safety and Health Act (act no. 57 of 1972) and for the purpose of implementing the Act, ordinance on prevention of anoxia, etc. shall be set forth as follows:

### Chapter I General Provisions

#### Article 1 (duties of the employer)

The employer shall make efforts to establish working methods, maintain a proper working environment and take measures necessary for preventing anoxia, etc.

#### Article 2 (definitions)

In this ordinance, the meanings of the terms are as defined respectively in the following items:

- (i) Oxygen deficiency: States under which the oxygen concentration in the air is less than 18%.
- (ii) Oxygen deficiency, etc.: The state defined in the preceding item or the state in which the concentration of hydrogen sulfide in the air is 10ppm or more.
- (iii) Anoxia: The symptom observed in one who has inhaled oxygen-deficient air.
- (iv) Hydrogen sulfide poisoning: The symptom observed in one who has inhaled the air in which the concentration of hydrogen sulfide is 10 ppm or more.
- (v) Anoxia, etc.: Anoxia or hydrogen sulfide poisoning.
- (vi) Hazardous work of oxygen deficiency: Those jobs to be carried out in places with the hazard of oxygen deficiency (hereinafter referred to as "oxygen-deficient places") designated in Attached Table 6 of the Enforcement Order (hereinafter referred to as "Cabinet Order") of the Industrial Safety and Health Law (cabinet ordinance no. 318 of 1972).
- (vii) Class-1 hazardous work of oxygen deficiency: The oxygen deficiency-hazard work other than class-2 hazardous work of oxygen deficiency out of the oxygen-deficiency-hazard works.
- (viii) Class-2 hazardous work of oxygen deficiency work: The work to be carried out in the oxygen-deficiency-hazard place designated in item 3-3, item 9 or item 12 of Attached Table 6 of the Cabinet Order (to be restricted to the places designated by the Minister of Health, Labour and Welfare as the places with the hazard of anoxia and hydrogen sulfide poisoning for the places designated in the said items) from among the oxygen-deficiency-hazard places.

### Chapter II General Preventive Measures

#### Article 3 (working environment measurement, etc.)

For the workplace designated in item 9 of Article 21 of Cabinet Order, the employer shall measure the concentration of the oxygen in the air before having the workers start the day's work, providing that the concentrations of both the oxygen and hydrogen sulfide shall be measured for workplaces where class-2 hazardous work of oxygen deficiency is to be carried out.

2. When the employer has made the measurements of the oxygen concentrations in the air provided for by the preceding paragraph, he shall make a record of the items given below, every time the said measurements have been made, and shall keep the recorded results of the said measurements in custody for a period of three years.

- (i) Date and time of the measurements
- (ii) Method of measurement
- (iii) Places at which the said measurements were carried out
- (iv) Conditions of measurements
- (v) Results of the measurements
- (vi) Name of the measurer
- (vii) Outline of the measures taken for prevention of anoxia based on the results of the measurements

#### Article 4 (measuring instruments)

When the employer has workers engage in hazardous work of oxygen-deficiency, he shall provide the instruments necessary for measurement of oxygen concentration in the air stipulated in Paragraph 1 of the preceding Article, or shall take measures for enabling the workers to easily make use of said instruments.

#### Article 5 (ventilation)

The employer whose workers engage in hazardous work of oxygen deficiency shall keep the concentration of oxygen in the air at least at 18% or more in the workplace (the concentration of the oxygen shall be 18% or more, and the concentration of the hydrogen sulfide, less than 10 ppm in the case of class-2 hazardous work of oxygen deficiency) by installing an appropriate ventilating system except in cases where a ventilating system cannot be installed in order to prevent explosion or oxidation, etc., and where it is extremely difficult to install a ventilating system due to the nature of the work to be carried out.

2. The employer shall not be allowed to use pure oxygen while the workplace is ventilated conforming to the provision of the preceding paragraph.

## Other Relevant Laws and Regulations

In addition to the foregoing laws and regulations, there are following relevant laws and regulations:

- Working Environment Measurement Act
- Fire Service Act
- Ship Safety Act
- Act on Maintenance of Sanitation in Buildings (building maintenance act)
- Act on Securing of Safety and Optimization of Transaction of Liquefied Petroleum Gas (liquefied petroleum gas act)
- Gas Business Act
- Act on Hot Springs

# Explosion-proof Construction

Explosion-proof electrical equipment are currently classified based on two types of standards.

One is Constructional Requirements for Electrical Equipment for Explosive Atmospheres of the Ministry of Labour Notification No. 16 of 1969 and another is its partial amendment, Recommended Practices for Explosion-Protected Electrical Installations in General Industries as referred to in the Ministry of Health, Labour and Welfare, Labour Standards Bureau Chief Notification No. 2 of August 24, 2010 issued by Labour Standards Bureau (JAPAN).

## [Constructional Requirements for Electrical Equipment for Explosive Atmospheres]

Types of Explosion-proof Construction of Electrical Equipment for Explosive Atmospheres and their Corresponding Symbols

Kind of type of gas-explosion protection	Symbol
Intrinsic safety	ia or ib
Flameproof enclosures	d
Pressurized enclosures	f
Increased safety	e
Oil-immersion	o
Type of protection 'n'	nA, nC, nR or nL
Encapsulation	ma or mb
Special	s

## Explosion Class Classification of Combustible Gases or Vapors

Explosion class	Limit of flame propagation (mm)
1	Over 0.6
2	Over 0.4 and less than 0.6
3 (a,b,c,n) <sup>*1</sup>	Equal to or less than 0.4

\*1 3a, 3b, 3c and 3n in the explosion class denote hydrogen and water gas, carbon disulfide, acetylene and all gases and vapors, respectively.

## Ignition Point Classification of Combustible Gases or Vapors

Ignition point	Ignition point (°C)	Permissible temperature of electrical equipment (°C)
G1	Over 450	360
G2	Over 300 and less than 450	240
G3	Over 200 and less than 300	160
G4	Over 135 and less than 200	110
G5	Over 100 and less than 135	80

Ignition points of representative explosive gas classes under the Constructional Requirements for Electrical Equipment for Explosive Atmospheres

Temperature class Explosion-proof class	G1	G2	G3	G4	G5
1	Acetone Ammonia Carbon monoxide Ethane Acetic acid Ethyl acetate Toluene Propane Benzene Methanol Methane	Ethanol Isopentyl acetate Butane	Gasoline Hexane	Acetaldehyde	
2		Ethylene Ethylene oxide			
3	Water gas Hydrogen	Acetylene			

## Display example

d3aG4

- d: Flameproof enclosures
- 3a: Limit of flame propagation of combustible gas (hydrogen and water gas) less than 0.4 mm
- G4: Ignition temperature over 135°C and less than 200°C

## [Recommended Practices for Explosion-Protected Electrical Installations in General Industries]

Types of Explosion-proof Construction of Electrical Equipment for Explosive Atmospheres and their Corresponding Symbols<sup>\*\*2</sup>

Kind of type of gas-explosion protection	Symbol
Intrinsic safety	ia or ib
Flameproof enclosures	d
Pressurized enclosures	px or py
Increased safety	e
Oil-immersion	o
Type of protection 'n'	nA, nC, nR or nL
Encapsulation	ma or mb
Special	s

\*\*2 To indicate the explosion-proof construction under the Recommended Practices for Explosion-Protected Electrical Installations in General Industries, "Ex" needs to be added in front of each explosion-proof class symbol.

Classification of Explosion-proof Electrical Equipment Corresponding to the Maximum Experimental Safe Gap<sup>\*\*3</sup>

Electrical equipment group of flameproof enclosure	Maximum experimental safe gap (mm)
II A	Equal to or more than 0.9
II B	Over 0.5 and less than 0.9
II C	Equal to or less than 0.5

Classification of Explosion-proof Electrical Equipment Corresponding to the Minimum Ignition Current<sup>\*\*3</sup>

Electrical equipment group of intrinsic safety	Minimum ignition current ratio (methane = 1)
II A	Over 0.8
II B	Equal to or more than 0.45 and equal to or less than 0.8
II C	Less than 0.45

\*\*3 Electrical equipment groups are classified into IIA, IIB and IIC but classification may differ depending on the type of explosion-proof construction.

Classification of Combustible Gases or Vapors Corresponding to the Temperature Class of Electrical Equipment

Maximum surface temperature of electrical equipment (°C)	Temperature class	Ignition temperatures of combustible gases or vapors (°C)
Less than 450	T1	Over 450
Equal to or less than 300	T2	Over 300 and less than 450
Equal to or less than 200	T3	Over 200 and less than 300
Equal to or less than 135	T4	Over 135 and less than 200
Equal to or less than 100	T5	Over 100 and less than 135
Equal to or less than 85	T6	Over 85 and less than 100

Temperature Classes of Representative Explosive Gases under the Recommended Practices for Explosion-Protected Electrical Installations in General Industries

Temperature class Explosion-proof class	T1	T2	T3	T4	T5	T6
II A	Acetone Ammonia Isobutane Ethane Acetic acid Ethyl acetate Toluene Benzene Methane	Isopentyl acetate Acetic anhydride Butane Propane Methanol	Hexane	Acetaldehyde		
II B	Carbon monoxide	Ethanol Ethylene Ethylene oxide				
II C	Water gas Hydrogen	Acetylene				Carbon disulfide

## Display example

ExdIICT5

- Ex: Symbol to indicate the explosion-proof construction under the Recommended Practices for Explosion-Protected Electrical Installations in General Industries
- d: Flameproof enclosures
- IIC: Maximum experimental safe gap less than 0.5 mm
- T5: Temperature of combustible gases or vapors over 100°C and less than 135 °C

# List of Detection Principles (Advantage, Construction, etc. of Various Principles)

	Principle and advantage	Construction	Output characteristics
<b>Catalytic Combustion</b> <b>HW</b>	<p>This method uses calorific power generated by combustible gases burning on oxidation catalyst (resistance variation of precious metal coil).</p> <ul style="list-style-type: none"> <li>● The sensor output is almost proportional (linear) to the concentration of gas up to the lower explosive limit.</li> <li>● There is almost no effect from the temperature and humidity of usage environment.</li> <li>● Good response with speedy reaction and excellent in accuracy and reproducibility.</li> </ul>		
<b>New Ceramic</b> <b>NC</b>	<p>This method uses calorific power generated by combustible gases burning on the originally developed super-atomization oxidative catalyst (new ceramics).</p> <ul style="list-style-type: none"> <li>● A single sensor can detect a wide range of concentrations from ppm to % LEL.</li> <li>● There is almost no effect from the temperature and humidity of usage environment.</li> <li>● Compared to the conventional catalytic combustion method sensor, it has excellent poisoning resistance, less sensitivity deterioration and prolonged stability.</li> </ul>		
<b>Semiconductor</b> <b>SG</b>	<p>This method uses resistance variations that occur when metallic oxide semiconductor contacts gases.</p> <ul style="list-style-type: none"> <li>● It has high sensor output in the low concentration range and has high sensitivity.</li> <li>● It can detect not only combustible gases but also various gases including toxic gas.</li> <li>● While controlling the sensitivity for miscellaneous gases, methane or isobutene can be detected selectively.</li> <li>● Compared to other methods, this method has large tolerance under the harsh environmental conditions.</li> </ul>		
<b>Thermal Conductivity</b> <b>TE</b>	<p>This method uses the difference in thermal conduction unique to gases when they contact heated element.</p> <ul style="list-style-type: none"> <li>● Up to 100 vol% gas concentration, the output is almost proportional (linear) to the concentration.</li> <li>● Without chemical reaction such as a combustion reaction, no deterioration or poisoning of catalyst ensures long and stable use.</li> <li>● With compensation element, it is almost free from the effect of the ambient environment.</li> <li>● Noncombustible gases such as high-concentration argon, nitrogen and carbon dioxide can be detected.</li> </ul>		
<b>Electrochemical</b> <b>ES</b>	<p>Gas is subject to electrolysis on electrodes kept at constant potential and the current generated then is detected as gas concentration.</p> <ul style="list-style-type: none"> <li>● Toxic gas can be detected with high sensitivity (e.g. arsine 0 to 0.2 ppm).</li> <li>● By choosing bias voltage, gas to be detected can be detected selectively.</li> <li>● Linear output enables accurate measurement of low-concentration gases.</li> </ul>		
<b>Galvanic cell</b> <b>OS</b>	<p>The current generated upon the electrolysis of oxygen on electrodes is detected as oxygen concentration.</p> <ul style="list-style-type: none"> <li>● Product can be made smaller and lighter.</li> <li>● No external power supply is needed for sensor operation.</li> <li>● Output up to 100 vol% is proportional to oxygen concentration.</li> <li>● Temperature compensation by a thermistor built in a sensor makes the temperature dependence of reading virtually nonexistent.</li> </ul>		
<b>Non-dispersive Infrared</b> <b>DE</b>	<p>This method uses the absorbed amount by gas of infrared rays radiated from the light source in the sensor.</p> <ul style="list-style-type: none"> <li>● It provides accurate and stable measurement.</li> <li>● Less sensitivity deterioration ensures stable measurement results for a long time.</li> <li>● It has less influence from coexisting gas, water vapor and the like and is excellent in selectivity.</li> <li>● As oxygen concentration has no effect, measurement is possible even in inert gas or N<sub>2</sub>.</li> </ul>		
<b>Flame ionization</b> <b>FID</b>	<p>This method uses the changes in current value by ionization of carbon hydride and other gases in hydrogen flame.</p> <ul style="list-style-type: none"> <li>● It features quick response and high sensitivity.</li> <li>● Output is almost proportional to the number of carbon in carbon hydride and will not be affected by inorganic carbon compound at all.</li> <li>● Output shows high linearity within the measurement range of concentration.</li> </ul>		
<b>Optical interferometric</b> <b>FI</b>	<p>This method uses the nature of light being refracted by gas.</p> <ul style="list-style-type: none"> <li>● Without using any chemical reaction, it has no deterioration in sensitivity and is excellent in prolonged stability.</li> <li>● Continuous measurement of gas concentration can be conducted with accuracy for various processes.</li> <li>● Measurement is possible in the order from 1000 ppm to 100 vol%.</li> </ul>		

## International Bases



## RIKEN KEIKI Co., Ltd.

Head office 2-7-6, Azusawa, Itabashi-ku, TOKYO, JAPAN 174-8744  
TEL +81-3-3966-1113 FAX +81-3-3558-9110

Web <http://www.rikenkeiki.co.jp/english>

- North America ..... United States
- South America ..... Brazil, Argentina, Peru, Chile, Uruguay
- Asia-Pacific ..... China, South Korea, Taiwan, Singapore, Malaysia, Indonesia, Thailand, India, Vietnam, Philippines, Australia
- Europe ..... Germany, Greece, Norway, Turkey, United Kingdom
- The Middle East ... United Arab Emirates, Israel
- Africa ..... South Africa
- Russia..... Russian Federation

※The contents described in this catalog are subject to change without notice according to the performance improvement.